

**CONSTRUCTION OF SANITATION FACILITIES
FOR EXISTING HOMES
AT SCATTERED SITES ON THE
MILLE LACS INDIAN RESERVATION
MILLE LACS, KANEBEC, AITKIN, AND PINE COUNTIES, MINNESOTA**

BE 17-L02

Jason Churchill

BID SCHEDULE


Schedule A - Individual Wastewater Facilities

NO.	DESCRIPTION	EST QTY	UNIT	UNIT COST	TOTAL COST
1	1600 Gallon Septic Tank	1	EA	_____	_____
2	1250 Gallon Pump Tank	1	EA	_____	_____
3	4" Solid PVC Pipe	25	FT	_____	_____
4	Two-way cleanout	1	EA	_____	_____
5	Effluent Pump With Controls	1	EA	_____	_____
6	Electric Cable	100	FT	_____	_____
7	2-inch Solid PVC Effluent Pipe	53	FT	_____	_____
8	Mound System Constructed on Existing Mound Site	1	LS	_____	_____
9	ISTS Permit	1	EA	_____	_____
10	Abandon Existing Tank	1	LS	_____	_____
Subtotal Schedule A				_____	_____

Contractor's Authorized Signature



This Page Intentionally Left Blank

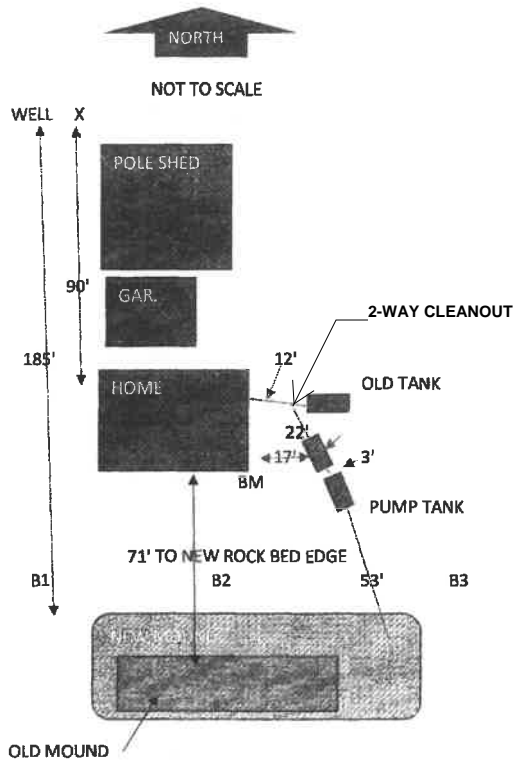

Site Elevation Sheet

LOCATION 3298 VELVET

BENCHMARK LOCATION TOP OF BASEMENT WALL ELEVATION 100.00

TANK #1 surface 96.40 inlet 93.70

TANK #2 surface inlet

PUMP TANK surface 96.74 inlet 93.20

REMOVE MOUND AND GRADE ROCK BED SURFACE TO 97.40

N.E. 97.40

N.W. 97.40

S.E. 97.40

S.W. 97.40

SAND TO ROCK BED INTERFACE ELEVATION 100.40

SOIL PITS OR BORINGS

#1 SURFACE 97.30	REDOX 96.55	WATER
#2 SURFACE 97.40	REDOX 96.70	WATER
#3 SURFACE 96.20	REDOX 95.60	WATER 95.10

E-Z EXCAVATING LLC.

2358 HWY# 23
MORA MN. 55051
Ph. 320-679-4031
Cell 320-241-7036

DESIGN

LOCATION: 3298 VELVET ST HINCKLEY MN.

OWNER: JASON CHURCHILL

SYSTEM TYPE: MOUND TYPE III

DESIGN FLOW: 3 BEDROOM DESIGNED @ 450 GPD

TREATMENT AREA: 380 SQ.FT.

MOUND SIZE: 42 X 74 '

SLOPE: GRADED 0 %

SEPTIC TANK: 1600 Gal. COMBO

FILTER: YES

PUMP TANK: 1200 Gal.

PUMP: GOULDS WE0511H

**FLOW METER: SJE-RHOMBUS TIMED DOSING WITH
CYCLE COUNTER**

KEVIN HERWIG M.P.C.A. 1472





**DESIGNER:
KEVIN HERWIG**

1520 EAST MAPLE AVE
MORA MN. 55051
EZEXCAVATING@YAHOO.
COM
Ph. 320-241-7036

PROJECT: 3298 VELVET ST. HINCKLEY MN.

THIS TYPE III MOUND OF SYSTEM IS TO BE CONSTRUCTED ON THE EXISTING MOUND SITE.

ALL PIPING, ROCK, AND DEBRIS IS TO BE REMOVED AND DISPOSED OF OFF SITE.

ALL SAND, LOAM COVER, AND TOPSOIL IS TO BE REMOVED ABOVE ORIGINAL ROUGH UP. SALVAGED TOPSOIL AND LOAM COVER MAY BE REUSED ON NEW MOUND SYSTEM. SALVAGED SAND MAY BE REUSED TO GRADE MOUND BASE AREA TO AN ELEVATION OF 94.70. THE ENTIRE MOUND BASE AREA IS TO BE GRADED TO AN ELEVATION OF 94.70

CARE MUST BE TAKEN TO NOT COMPACT THE ABSORPTION AREA DURING THAT MATERIAL REMOVAL

ONCE THE MATERIAL IS REMOVED SUFFICIENT TIME MUST BE ALLOWED FOR MOUND AREA TO DRY. AFTER SUFFICIENT DRYING TIME AND ACCEPTABLE PLASTIC LIMIT CAN BE ACHIEVED THE MOUND AREA CAN BE ROUGHED UP AND CONSTRUCTION MAY BEGIN.

DUE TO THE INCREASED SLOPE OF THE EAST AND OF THE MOUND SYSTEM THE ABSORPTION AREA IS TO BE INCREASED TO 12' BEYOND THE END OF THE ROCK BED. ABSORPTION ON THE OTHER THREE SIDES IS 8' BEYOND THE ROCK BED.

CONSTRUCTION NOTES

PRODUCT BRAND & MODEL LISTED IN DESIGN MUST BE USED. (CEMSTONE TANKS –1 SEPTIC 1600 GAL. COMBO(#9551601) W/ POLYLOK PL-122 FILTER WITH ALARM, 1-PUMP TANK 1250 GAL.(# 9551251) PUMP – GOULDS WE0511H) PUMP CHAMBER AND PUMP SETTINGS WILL NOT BE CORRECT IF OTHER PRODUCTS ARE USED.**

SJE RHOMBUS - TDIW924H8C21E TIMED DOSING CONTROL WITH CYCLE COUNTER

IT IS THE DESIGNERS DISCRETION TO APPROVE OR DISAPPROVE SUBSTITUTIONS.THE INSTALLER WILL BE RESPONSIBLE FOR DESIGN CHANGE FEE.

ALL PRODUCTS AND CONSTRUCTION PRACTICES ARE TO MEET M.P.C.A. 7080 RULE AND MILLE LACS BAND SPECIFICATION FOR SEWAGE TREATMENT SYSTEMS

KEVIN HERWIG LIC # 1472





v 05.13.14

1. Contact Information

Property Owner/Client: JASON CHURCHILL Client Phone Number: _____
 Mailing Address: 3298 VELVET ST HINCKLEY MN Project ID: _____
 Site Address: SAME Legal Description: _____
 Parcel ID: 13.00030.0 Latitude: _____ Longitude: _____
 Evaluation for system type: New Construction Replacement Date: September 27, 2018

2. Flow Information

Client-Provided Information
 Type(s) of use (all that apply) Residential Commercial Other (Specify) _____
 No. of bedrooms* (if applicable) 3 Unfinished space (ft²) _____
 No. of residents in home 2 Adults 5 Children Teenagers
 Existing flow measurements Yes (if Yes, attach readings) No

Water-using devices (check all that apply)
 Dishwasher Water Softener* Ion Filter*
 Large Refrigerator/Freezer Sump Pump* Other (specify) _____
 Laundry/Large Tub on 2nd Floor Hot Tub* * Clear water source

Water use concerns (check all that apply)
 Leaky/Faulty Toilets Multiple Loads of Laundry/Day Long-Term Prescription Meds Use of Anti-Bacterial Soap
 In-Home Business No Lint Screen Frequent Entertaining of Out-of-Town Guests

Any additional current or future uses on this parcel (specify) _____
 Any non-sewage discharges to system (specify) _____
 Sewage ejector or grinder pump in home? Yes No
 I acknowledge the above is complete and accurate (Client's signature and date) _____
 Designer-determined Flow Information
 A. Estimated Design Flow (gallons per day) 450
 Anticipated waste strength values: Domestic Strength High Strength BOD: _____ mg/L
 CBOD: _____ mg/L (TSS): _____ mg/L O&G: _____ mg/L

3. Preliminary Site Information

B(1). Water supply well(s) within 100 ft of absorption area Yes No
 Well(s) were located Direct Observation Ground Well Index Map Personal Communication MN Unique Well Id #: _____
 Depth of well(s) OVER 55' ft Well casing depth(s) OVER 55' ft Source: _____
 Impervious Layer No Yes If Yes, Define & Source: _____ Required Setback: _____ ft
 B(2). Site within 200 ft of noncommunity transient supply well Yes No Source: _____
 B(3). Site within a drinking water supply management area Yes No Source: _____
 B(4). Location of all existing and proposed buildings and improvements on lot (see Site Evaluation map)
 B(5). Buried water supply pipes within 50 ft of proposed system Yes No Source: _____
 C. Location of all easements on lot (see Site Evaluation map) Source: _____
 D. Elevation of ordinary high water level (OWHL) - MN DNR (if adjacent to parcel) NA
 E. Floodplain designation and flood elevation NA Source: _____
 F. Determine property lines (see Site Evaluation map) Survey Aerial Map Other: _____
 Site located in a shoreland district/area Yes No _____
 G. Distance of setbacks Other buildings Sewer Water Supply Pipes Well(s)



1. Contact Information Project ID: _____ v 05.13.14

Property Owner/Client: JASON CHURCHILL Client Phone Number: _____

Address: 3298 VELVET ST HINGKLEY MN _____

Date: 9/27/2018 Weather Conditions: OVERCAST

2. Utility and Structure Information

Utility Locations Identified Cooper State One Call # _____ Any Private UTILITIES _____

Property Lines Determined and Approved by Client _____ Client's Approval (Initial) _____

Determined but not Approved _____

Approximate _____

Property Lines Surveyed _____

Locate and Verify (see Site Evaluation map)

Existing Buildings Improvements Easements Setbacks

3. Site Information

Percent Slope: _____ Slope Direction: _____

Landscape Position: SHOULDER Slope Shape: LIN

Vegetation type(s): _____ LAWN _____

Evidence of cut, fill, compacted or disturbed areas Yes No

Discuss the flooding or run-on potential of site: _____

Identify benchmarks and elevations (Site Evaluation Map): TOP OF BASEMENT BLOCK 100.00

Proposed soil treatment area adequately protected Yes No

4. General Soils Information

Original soils Yes No

Type of observation Soil Probe Soil Boring Soil Pit

Number of soil observations: 3

Soil observations were conducted in the proposed system location Yes No

A soil observation was made within the most limiting area of the proposed system Yes No

Soil boring log forms completed and attached Yes No

Percolation tests performed, forms completed and attached Yes No


5. Phase I. Reporting Information

Depth to standing water	13	Inches	Anticipated construction issues
Flood elevation	NA	feet	
Depth to bedrock	NA	Inches	
Depth to periodically saturated soil	9	Inches	
Maximum depth of system		Inches	
Elevation at system bottom	97.4	feet	Differences between soil survey and field evaluation
Percolation rate		mIn/Inch	
Loading rate	0.42	gpd/ft ²	
Contour loading rate	12	gpd/ft	

Site evaluation issues / comments

I hereby certify that I have completed this work in accordance with all applicable ordinances, rules and laws.

KEVIN HERWIG 1472 09/27/18

(Designer)  (License #) (Date)



Client/ Address: 3298 VELVET		Legal Description / GPS:					
Soil parent material(s): (Check all that apply) <input type="checkbox"/> Outwash <input type="checkbox"/> Lacustrine <input type="checkbox"/> Loess <input checked="" type="checkbox"/> Till <input type="checkbox"/> Alluvium <input type="checkbox"/> Bedrock <input type="checkbox"/> Organic Matter							
Landscape Position: (check one) <input type="checkbox"/> Summit <input type="checkbox"/> Shoulder <input type="checkbox"/> Back/Side Slope <input type="checkbox"/> Foot Slope <input checked="" type="checkbox"/> Toe Slope Slope shape: _____							
Vegetation: LAWN	Soil survey map units: C12A	Slope%: 1.0	Elevation: 97.3				
Weather Conditions/Time of Day: 11AM OVERCAST		Date: 09/27/18	Soil Pit				
Observation #/Location: NW 1		Observation Type: _____					
Depth (in)	Rock Texture	Matrix Color(s)	Mottle Color(s)	Redox Kind(s)	Indicator(s)	Shape	Consistence
0-8	Silt Loam	<35%	10YR 3/2			Blocky	Weak Friable
8-11	Silt Loam	<35%	7.5YR 5/3	2.5YR 5/6	S1	Blocky	Weak Friable
11-20	Silt Loam	<35%	7.5YR 4/3	2.5YR 5/6	S1	Platey	Moderate Friable
Comments							
I hereby certify that I have completed this work in accordance with all applicable ordinances, rules and laws.							
KEVIN HERWIG (Designer/Inspector)						1472 (License #)	9/27/2018 (Date)

Kevin Herwig
Signature



Additional Soil Observation Logs

Project ID:

Client/ Address:		Legal Description/ GPS:	
Soil parent material(s): (Check all that apply) <input type="checkbox"/> Outwash <input type="checkbox"/> Lacustrine <input type="checkbox"/> Loss <input checked="" type="checkbox"/> Till <input type="checkbox"/> Alluvium <input type="checkbox"/> Bedrock <input type="checkbox"/> Organic Matter			
Landscape Position: (check one) <input type="checkbox"/> Summit <input type="checkbox"/> Shoulder <input type="checkbox"/> Back/Side Slope <input type="checkbox"/> Foot Slope <input checked="" type="checkbox"/> Toe Slope Slope shape			
Vegetation	LAWN	Slope%	1.0
Weather Conditions/Time of Day:	Soil survey map units C1ZA	Elevation:	97.4
Observation #/Location:	NE CENTER 2	Date	09/27/18
Depth (in)	Texture	Rock Frag. %	Indicator(s)
0-8	Silt Loam	<35%	Shape: Blocky Grade: Weak Consistence: Friable
8-11	Silt Loam	<35%	Concentrations S1
11-18	Silt Loam	<35%	Concentrations S1 Platey Moderate Friable
Comments			

Observation #/Location:				E.3				Soil Pit			
Depth (in)	Texture	Rock Frag. %	Indicator(s)	Redox Kind(s)	Mottle Color(s)	Matrix Color(s)	Shape	Grade	Consistence		
0-8	Silt Loam	<35%	10YR 3/2			10YR 3/2	Blocky	Weak	Friable		
8-11	Silt Loam	<35%	7.5YR 5/3	Concentrations S1	2.5YR 5/6	7.5YR 5/3	Blocky	Weak	Friable		
11-13	Silt Loam	<35%	7.5YR 4/3	Concentrations S1	2.5YR 5/6	7.5YR 5/3	Blocky	Weak	Friable		
Comments WATER AT 13"											

LOCATION: BRENNYVILLE MN+WI

Established Series
Fertile YDS-IFG-AGG
1:2:06**BRENNYVILLE SERIES**

The Brennyville series consists of very deep, somewhat poorly drained soils that formed in a silty mantle of a thin layer of lacustrine deposits and dense loamy glacial till on ground and end moraines. A dense contact layer is present at depths of 40 to 60 inches. Slopes range from 0 to 6 percent. Mean annual precipitation is about 28 inches. Mean annual air temperature is about 43 degrees F.

TAXONOMIC CLASS: Coarse-loamy, mixed, superactive, frigid Aquic Glossudalfs

TYPICAL PEDON: Brennyville silt loam on a slightly convex slope of 1 percent in a cultivated field. (Color values are for moist soil unless otherwise stated.)

Ap—0 to 8 inches; very dark grayish brown (10YR 3/2) silt loam, grayish brown (10YR 5/2) dry; weak fine and medium subangular blocky structure; friable; about 1 percent gravel; strongly acid; abrupt smooth boundary. (0 to 1.5 inches thick)

E/E—8 to 11 inches; 75 percent brown (10YR 5/3) silt loam (Bt); with about 25 percent tongues of grayish brown (10YR 5/2) silt loam (E); weak fine and medium subangular blocky structure; common fine distinct light olive brown (2.5Y 5/6) Fe concentrations; friable; about 1 percent gravel; strongly acid; gradual wavy boundary. (5 to 10 inches thick)

E4—1 to 21 inches; brown (10YR 4/3) silt loam; moderate fine and medium subangular blocky structure; common fine distinct light olive brown (2.5Y 5/6) Fe concentrations and fine faint grayish brown (2.5Y 5/6) Fe depletions; friable; common distinct discontinuous dark olive brown (2.5Y 3/3) clay films on faces of plates; about 1 percent gravel; strongly acid; clear wavy boundary. (0 to 10 inches thick)

2B2—21 to 28 inches; brown (7.5YR 4/3) loam; moderate medium platy structure parting to thin platy; medium faint grayish brown (10YR 5/2) Fe depletions and common medium distinct dark yellowish brown (10YR 4/6) Fe concentrations; friable; few distinct discontinuous dark brown (7.5YR 3/3) clay films on faces of plates; about 3 percent gravel; strongly acid; gradual wavy boundary.

2B3—28 to 38 inches; brown (7.5YR 4/4) fine sandy loam; moderate medium platy structure parting to thin platy; few medium distinct brown (7.5YR 5/3) Fe depletions and common fine distinct dark strong brown (7.5YR 4/6) Fe concentrations; friable; few distinct discontinuous dark brown (7.5YR 3/4) clay films on faces of plates; about 3 percent gravel; strongly acid; gradual wavy boundary. (Combined thickness of the 2B2 and 2B3 horizons is 6 to 20 inches)

2B4—38 to 45 inches; dark reddish brown (5YR 3/4) fine sandy loam; moderate thick platy structure; few fine and medium faint reddish brown (5YR 5/3) Fe depletions and few medium distinct yellowish red (5YR 4/6) Fe concentrations; few thin distinct brown and dark brown (7.5YR 3/4) clay films on bottoms of plates; about 3 percent gravel and 2 percent cobbles; slightly acid; gradual wavy boundary. (0 to 12 inches thick)

2B4d—45 to 80 inches; dark reddish brown (5YR 3/4) fine sandy loam; moderate very coarse and extremely coarse prismatic structure parting to moderate fine and medium platy, few 2 to 3 millimeter oblique fractures to 3.0 feet apart; very firm; few faint reddish brown (5YR 5/3) Fe depletions and yellowish red (5YR 4/6) Fe concentrations on fracture faces; about 5 percent gravel and 2 percent cobbles; slightly acid.



Property Owner/Client: <u>JASON CHURCHILL</u>		Project ID: <u>MILLE 1-18</u> v <u>04.20.2016</u>	
Site Address: <u>3208 VELVET ST. HINGOLEY MN.</u>		Date: <u>9/27/18</u>	
1. DESIGN FLOW, STRENGTH OF WASTE, AND TANKS			
A. Design Flow: <u>450</u> Gallons Per Day (GPD)		Number of Bedrooms (Residential): <u>3</u>	
Type of Wastewater: <u>Residential</u>	Treatment Level: <u>C</u>	Nutrients: _____	
Commercial (select method and provide data): <input type="checkbox"/> Measured Flow: _____ GPD		<input type="checkbox"/> Estimated Flow: _____ GPD	
B. Septic Tanks:			
Minimum Code Required Septic Tank Capacity (Dwellings): <u>1500</u> Gallons, in <u>2</u> Tanks or Compartments		Minimum Septic Tank Capacity for Other Establishments = Design Flow X 3.0 if received by gravity or 4.0 if received by pressure	
Waste received by: _____ GPD X _____ = _____ Gallons		Recommended Septic Tank Capacity: _____ Gallons, in _____ Tanks or Compartments	
Effluent Screen & Alarm: <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> Optional <input type="checkbox"/> Screen Only Effluent Screen Manufacturer/Model: _____			
C. Holding Tanks Only: Minimum Capacity: Residential = 400 gal/bedroom, Other Establishment = Design Flow x 5.0. Minimum size 1000 gallons			
Minimum Code Required Capacity: _____ Gallons, in _____ Tanks		Type of High Level Alarm: _____	
Designer Recommended Capacity: _____ Gallons, in _____ Tanks		_____	
D. Pump Tank 1 Capacity (Code Minimum): <u>650</u> Gallons		Pump Tank 2 Capacity (Code Minimum): _____ Gallons	
Pump Tank 1 Capacity (Designer Rec): <u>1250</u> Gallons		Pump Tank 2 Capacity (Designer Rec): _____ Gallons	
Pump 1 <u>29.0</u> GPM	Total Head <u>18.5</u> ft	Pump 2 _____ GPM	Total Head _____ ft
Supply Pipe Dia. <u>2.00</u> in	Dose Volume: <u>160.0</u> gal	Supply Pipe Dia. _____ in	Dose Volume: _____ gal
2. SYSTEM AND DISTRIBUTION TYPE			
Soil Treatment Area Type: <u>Mound</u>		Distribution Type: <u>Pressure Distribution-Level</u>	
Benchmark Reference Elevation: <u>100.00</u> ft		Benchmark Location: <u>TOP OF BASEMENT</u>	
MPCA Type: <u>Type III</u>		Type of Distribution Media: <input checked="" type="checkbox"/> Drainfield Rock <input type="checkbox"/> Registered Treatment Media:	
Comments: <u>EXISTING MOUND SITE</u>			
3. SITE EVALUATION:			
A. Depth to Limiting Layer: <u>0</u> in <u>0.0</u> ft		G. Soil Texture: <u>Silt Loam</u>	
B. Elevation of Limiting Layer: <u>96.6</u>		H. Soil Hyd. Loading Rate: <u>0.42</u> GPD/ft ²	
C. Loc. of Restrictive Elevation: <u>1</u>		I. Perc. Rate: _____ MPI	
D. Minimum Required Separation: <u>36</u> in <u>3.0</u> ft		J. Soil with >35% Rock Fragments Present? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	
E. Code Maximum Depth of System: <u>Mound</u> in		If yes describe below: % rock and layer thickness, amount of soil credit and any additional information for addressing the rock fragments in this design.	
F. Measured Land Slope %: <u>0.0</u> %		Comments: _____	
4. DESIGN SUMMARY			
Trench Design Summary			
Dispersal Area: _____ ft ²	Sidewall Depth: _____ in	Trench Width: _____ ft	
Total Lineal Feet: _____ ft	Number of Trenches: _____	Code Maximum Trench Depth: _____ in	
Contour Loading Rate: _____ ft	Min Trench Length: _____ ft	Designer's Max Trench Depth: _____ in	



Bed Design Summary

Absorption Area ft² Depth of sidewall in Code Maximum Bed Depth in
 Bed Width ft Bed Length ft Designer's Max Bed Depth in

Mound Design Summary

Absorption Bed Area ft² Bed Length ft Bed Width ft
 Absorption Width ft Clean Sand Lift ft Berm Width (0-1%) ft
 Upslope Berm Width ft Downslope Berm Width ft Endslope Berm Width ft
 Total System Length ft Total System Width ft Contour Loading Rate gal/ft

At-Grade Design Summary

Absorption Bed Width ft Absorption Bed Length ft System Finished Height ft
 Contour Loading Rate gal/ft Upslope Berm Width ft Downslope Berm Width ft
 Endslope Berm Width ft System Length ft System Width ft

Level & Equal Pressure Distribution Summary

No. of Perforated Laterals Perforation Spacing ft Perforation Diameter in
 Lateral Diameter in Min. Delivered Volume gal Maximum Delivered Volume gal

Non-Level and Unequal Pressure Distribution Summary

	Elevation (ft)	Pipe Size (in)	Pipe Volume (gal/ft)	Pipe Length (ft)	Perforation Size (in)	Spacing (ft)	Spacing (in)	
Lateral 1								Minimum Delivered Volume <input type="text" value=""/> gal Maximum Delivered Volume <input type="text" value=""/> gal
Lateral 2								
Lateral 3								
Lateral 4								
Lateral 5								
Lateral 6								

5. **Additional Info for Type IV/Pretreatment Design**

A. Calculate the organic loading


1. Organic Loading to Pretreatment Unit = Design Flow X Estimated BOD In mg/L in the effluent X 8.35 + 1,000,000
 gpd X mg/L X 8.35 + 1,000,000 = lbs BOD/day

2. Type of Pretreatment Unit Being Installed:

3. Calculate Soil Treatment System Organic Loading: BOD concentration after pretreatment + Bottom Area = lbs/day/ft²
 mg/L X 8.35 + 1,000,000 + ft² = lbs/day/ft²

Comments/Special Design Considerations:

I hereby certify that I have completed this work in accordance with all applicable ordinances, rules and laws.

KEVIN HERWIG (Designer)  1472 (License #) 09/27/18 (Date)

1. SYSTEM SIZING: Project ID: MILLE 1-18 v 04.20.2016

- A. Design Flow : GPD
- B. Soil Loading Rate: GPD/ft²
- C. Depth to Limiting Condition: ft
- D. Percent Land Slope: %
- E. Design Media Loading Rate: GPD/ft²
- F. Mound Absorption Ratio:

Percolation Rate (MP)	Treatment Level C		Treatment Level A, A-2, B	
	Absorption Area Loading Rate (gal/ft ²)	Mound Absorption Ratio	Absorption Area Loading Rate (gal/ft ²)	Mound Absorption Ratio
<0.1	-	1	-	1
0.1 to 0.5	1.2	1	1.6	1
0.1 to 0.5 (fine sand and loamy fine sand)	0.6	2	1	1.6
6 to 15	0.78	1.6	1	1.6
16 to 30	0.6	2	0.78	2
31 to 45	0.5	2.4	0.78	2
46 to 60	0.45	2.6	0.6	2.6
61 to 120	-	5	0.3	5.3
>120	-	-	-	-

Measured Perc Rate	OR	Testura - derived mound absorption ratio	Contour Loading Rate
≤ 60mpi	OR	1.0, 1.3, 2.0, 2.4, 2.6	≤ 12
61-120 mpi	OR	5.0	≤ 12
≥ 120 mpi*	OR	>5.0*	≤ 6*

*Systems with these values are not Type I systems. Contour Loading Rate (linear loading rate) is a recommended value.

2. DISPERSAL MEDIA SIZING

- A. Calculate Dispersal Bed Area: Design Flow (1.A) ÷ Design Media Loading Rate (1.E) = ft²

$$\frac{450 \text{ GPD}}{1.2 \text{ GPD/ft}^2} = 375 \text{ ft}^2$$

If a larger dispersal media area is desired, enter size: ft²
- B. Enter Dispersal Bed Width: ft *Can not exceed 10 feet.*
- C. Calculate Contour Loading Rate: Bed Width (2.B) X Design Media Loading Rate (1.E)

$$10 \text{ ft} \times 1.2 \text{ GPD/ft}^2 = 12.0 \text{ gal/ft}$$
 Can not exceed Table 1
- D. Calculate Minimum Dispersal Bed Length: Dispersal Bed Area (2.A) ÷ Bed Width (2.B) = Bed Length

$$\frac{375 \text{ ft}^2}{10 \text{ ft}} = 37.5 \text{ ft}$$

3. ABSORPTION AREA SIZING

- A. Calculate Absorption Width: Bed Width (2.B) X Mound Absorption Ratio (1.F) = Absorption Width

$$10.0 \text{ ft} \times 2.6 = 26.0 \text{ ft}$$
- B. For slopes from 0 to 1%, the Absorption Width is measured from the bed equally in both directions.
 Absorption Width Beyond the Bed: Absorption Width (3.A) - Bed Width (2.B) + 2 = Width beyond Bed

$$(26.0 \text{ ft} - 10.0 \text{ ft}) \div 2 = 8.0 \text{ ft}$$

4. DISTRIBUTION MEDIA: ROCK

A. Rock Media Depth Below Distribution Pipe

0.50 ft estimated volume of rock on mound materials page

5. DISTRIBUTION MEDIA: REGISTERED TREATMENT PRODUCTS: CHAMBERS AND EZFLOW

A. Enter Dispersal Media:

B. Enter the Component: Length: ft Width: ft Depth: ft

C. Number of Components per Row = Bed Length divided by Component Length (Round up)

ft ÷ ft = components/row

D. Actual Bed Length = Number of Components/row X Component Length:

components X ft = ft

E. Number of Rows = Bed Width divided by Component Width

ft ÷ ft = rows Adjust width so this is an whole number.

F. Total Number of Components = Number of Components per Row X Number of Rows

X = components

6. MOUND SIZING

A. Calculate Clean Sand Lift: 3 feet minus Depth to Limiting Condition = Clean Sand Lift (1 ft minimum)

3.0 ft - ft = 3.0 ft Design Sand Lift (optional): ft

B. Upslope Mound Height = Clean Sand Lift + Depth of Media + Depth of Cover (1 ft)

3.0 ft + 0.75 ft + 1.0 ft = 4.8 ft

C. Berm Width = Upslope Mound Height (4.B) X 4 (4 is recommended, but could be 3-12)

4.8 ft X ft = 0.0 ft

D. Total Landscape Width = Berm Width + Dispersal Bed Width + Berm Width

0.0 ft + 10.0 ft + 0.0 ft = 10.0 ft

E. Additional Berm Width necessary for absorption = Absorption Width - Total Landscape Width

26.0 ft - 10.0 ft = 16.00 ft if number is negative (<0), value is ZERO

F. Final Berm Width = Additional Berm Width + Berm Width

16.00 ft + 0.0 ft = 16.0 ft

G. Total Mound Width = Final Berm Width + Dispersal Bed Width + Final Berm Width

16.0 ft + 10.0 ft + 16.0 ft = 42.0 ft



H. Total Mound Length = Final Berm Width + Dispersal Bed Length + Final Berm Width

16.0 ft + 37.5 ft + 16.0 ft = 69.5 ft

I. Setbacks from the Bed: Absorption Width - Dispersal Bed Width divided by 2

(26.0 ft - 10.0) / 2 = 8.0 ft

7. MOUND DIMENSIONS

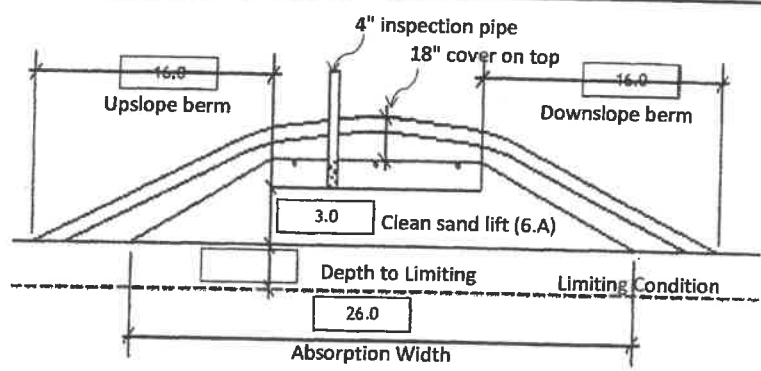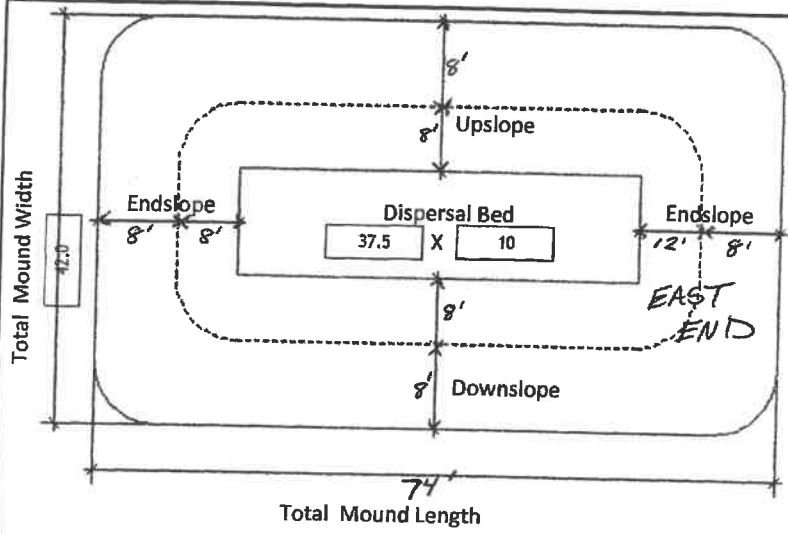

Comments:

ABSORPTION WIDTH SAND ON EAST END OF MOUND TO EXTEND 12' PAST END OF ROCK BED



12. Calculate the *Square Feet per Perforation*. Recommended value is 4-11 ft² per perforation.
Does not apply to At-Grades

a. *Bed Area* = Bed Width (ft) X Bed Length (ft)

10 ft X 38 ft = 380 ft²

b. *Square Foot per Perforation* = Bed Area divided by the Total Number of Perforations.

380 ft² ÷ 39 perforations = 9.7 ft²/perforations

13. Select *Minimum Average Head*: 1.0 ft

14. Select *Perforation Discharge* (GPM) based on Table: 0.74 GPM per Perforation

15. Determine required *Flow Rate* by multiplying the Total Number of Perfs. by the Perforation Discharge.

39 Perfs X 0.74 GPM per Perforation = 29 GPM

16. *Volume of Liquid Per Foot of Distribution Piping* (Table II): 0.170 Gallons/ft

17. *Volume of Distribution Piping* =



= [Number of Perforated Laterals X Length of Laterals X (Volume of Liquid Per Foot of Distribution Piping)]

3 X 36 ft X 0.170 gal/ft = 18.4 Gallons

18. *Minimum Delivered Volume* = Volume of Distribution Piping X 4

18.4 gals X 4 = 73.4 Gallons

Pipe Diameter (Inches)	Liquid Per Foot (Gallons)
1	0.045
1.25	0.078
1.5	0.110
2	0.170
3	0.380
4	0.661

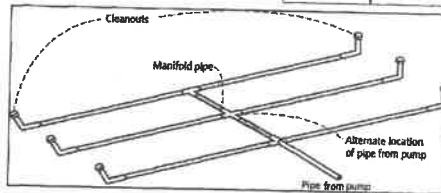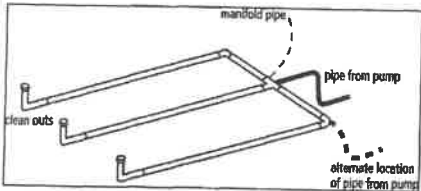

Comments/Special Design Considerations:

Blank space for comments or special design considerations.

OSTP Basic Pump Selection Design Worksheet



1. PUMP CAPACITY

Project ID: MILLE 1-18

v 04.20.2016

Pumping to Gravity or Pressure Distribution: Gravity Pressure

1. If pumping to gravity enter the gallon per minute of the pump: GPM (10 - 45 gpm)

2. If pumping to a pressurized distribution system: GPM

3. Enter pump description:


Demand Dosing Soil Treatment

2. HEAD REQUIREMENTS

A. Elevation Difference between pump and point of discharge: 12 ft

B. Distribution Head Loss: 5 ft

C. Additional Head Loss: ft (due to special equipment, etc.)

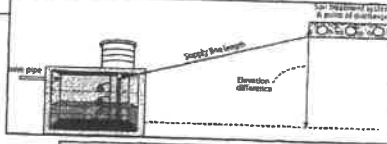

Distribution Head Loss	
Gravity Distribution - 0ft	
Pressure Distribution based on Minimum Average Head Value on Pressure Distribution Worksheet:	
Minimum Average Head	Distribution Head Loss
1ft	5ft
2ft	6ft
5ft	10ft

Flow Rate (GPM)	Pipe Diameter (inches)			
	1	1.25	1.5	2
10	9.1	3.1	1.3	0.3
12	12.8	4.3	1.8	0.4
14	17.0	5.7	2.4	0.6
16	21.8	7.3	3.0	0.7
18		9.1	3.8	0.9
20		11.1	4.6	1.1
25		16.8	6.9	1.7
30		23.5	9.7	2.4
35			12.9	3.2
40			16.5	4.1
45			20.5	5.0
50				6.1
55				7.3
60				8.6
65				10.0
70				11.4
75				13.0
85				16.4
95				20.1

D. 1. Supply Pipe Diameter: 2.0 in

2. Supply Pipe Length: 54 ft

E. Friction Loss in Plastic Pipe per 100ft from Table 1:

Friction Loss = 2.23 ft per 100ft of pipe

F. Determine Equivalent Pipe Length from pump discharge to soil dispersal area discharge point. Estimate by adding 25% to supply pipe length for fitting loss. Supply Pipe Length (D.2) X 1.25 = Equivalent Pipe Length

54 ft X 1.25 = 67.5 ft

G. Calculate Supply Friction Loss by multiplying Friction Loss Per 100ft (Line E) by the Equivalent Pipe Length (Line F) and divide by 100.

Supply Friction Loss = 2.23 ft per 100ft X 67.5 ft ÷ 100 = 1.5 ft

H. Total Head requirement is the sum of the Elevation Difference (Line A), the Distribution Head Loss (Line B), Additional Head Loss (Line C), and the Supply Friction Loss (Line G)

12.0 ft + 5.0 ft + ft + 1.5 ft = 18.5 ft

3. PUMP SELECTION

A pump must be selected to deliver at least 29.0 GPM (Line 1 or Line 2) with at least 18.5 feet of total head.

Comments:



Project ID: MILE 1-18 V 04.20.2016

DETERMINE TANK CAPACITY AND DIMENSIONS

1. A. Design Flow (Design Sum. 1A): GPD
 B. Min. required pump tank capacity: Gal
 C. Recommended pump tank capacity: Gal

2. A. Tank Manufacturer:
 B. Tank Model:
 C. Capacity from manufacturer: Gallons
 D. Gallons per inch from manufacturer: Gallons per inch
 E. Liquid depth of tank from manufacturer: inches

Note: Design calculations are based on this specific tank. Substituting a different tank model will change the pump float or timer settings. Contact designer if changes are necessary.

DETERMINE DOSING VOLUME

3. Calculate Volume to Cover Pump (The inlet of the pump must be at least 4-inches from the bottom of the pump tank & 2 inches of water covering the pump is recommended)
 (Pump and block height + 2 inches) X Gallons Per Inch (2C or 3E)
 in + 2 inches X Gallons Per Inch = Gallons

4. Minimum Delivered Volume = 4 X Volume of Distribution Piping:
 - Line 17 of the Pressure Distribution or Line 11 of Non-level Gallons (minimum dose)

5. Calculate Maximum Pumpout Volume (25% of Design Flow)
 Design Flow: GPD X 0.25 = Gallons (maximum dose)

6. Select a pumpout volume that meets both Minimum and Maximum: Gallons

7. Calculate Doses Per Day = Design Flow + Delivered Volume
 gpd + gal = Doses

8. Calculate Drainback:
 A. Diameter of Supply Pipe = inches
 B. Length of Supply Pipe = feet
 C. Volume of Liquid Per Linear Foot of Pipe = Gallons/ft
 D. Drainback = Length of Supply Pipe X Volume of Liquid Per Linear Foot of Pipe
 ft X gal/ft = Gallons

9. Total Dosing Volume = Delivered Volume plus Drainback
 gal + gal = Gallons

10. Minimum Alarm Volume = Depth of alarm (2 or 3 inches) X gallons per inch of tank
 in X gal/in = Gallons

Pipe Diameter (inches)	Liquid Per Foot (Gallons)
1	0.045
1.25	0.078
1.5	0.110
2	0.170
3	0.380
4	0.661

TIMER FLOAT SETTINGS

11. Required Flow Rate:
 A. From Design (Line 12 of Pressure, Line 10 of Non-Level or Line 6 of Pump): GPM
 B. Or calculated: GPM = Change in Depth (in) X Gallons Per Inch / Time Interval in Minutes
 in X gal/in + min = GPM


12. Flow Rate from Line 12.A or 12.B above: GPM

13. Calculate TIMER ON setting:
 Total Dosing Volume / GPM
 gal ÷ GPM = Minutes ON

14. Calculate TIMER OFF setting:
 Minutes Per Day (1440) / Doses Per Day - Minutes On
 1440 min ÷ doses/day - min = Minutes OFF

15. Pump Off Float - Measuring from bottom of tank:
 Distance to set Pump Off Float = Gallons to Cover Pump / Gallons Per Inch:
 gal ÷ gal/in = Inches

16. Alarm Float - Measuring from bottom of tank (90% recommended):
 Distance to set Alarm Float = Tank Depth X % of Tank Depth (0.9 recommended)
 in X = in



TYPE III SEPTIC SYSTEM

THIS SEPTIC SYSTEM IS CLASSIFIED TYPE III DUE TO SOIL TYPE, CONDITION AND PLACEMENT ON EXISTING MOUND SITE

TYPE III SYSTEMS ARE NOT WARRANTED BY THE DESIGNER, INSTALLER, OR THE LOCAL UNIT OF GOVERNMENT.

IF THE SYSTEM FAILS IT IS THE PROPERTY OWNERS RESPONSIBILITY TO HAVE THE SYSTEM REPAIRED AT THEIR EXPENSE.

A MANAGEMENT PLAN WILL BE PROVIDED WITH THE DESIGN

THE MANAGEMENT PLAN MUST BE FOLLOWED OR YOUR SYSTEM WILL BE IN NONCOMPLIANCE .

KEVIN HERWIG M.P.C.A. LIC# 1472

**PROPERTY
OWNER _____ DATE _____**

MONITORING AND MITIGATION

SEPTIC SYSTEM CLASSIFIED AS TYPE III

Should the system failed a new site for the septic system may be considered or the owner agrees to repair the septic system if it is possible if the septic system is not repairable the homeowner agrees to disconnect the septic tanks from the septic system and use and maintain the septic tanks as holding tanks.

KANABEC COUNTY and Kevin Herwig are to be notified as soon as possible about any operational problems. If a failure occurs the septic pump must be disconnected immediately and remain disconnected until any and all repairs are completed. A pumping contract will need to be set up with a septic maintenance contractor. A copy of all documents must be submitted to the county.

The system must be monitored for a minimum of three years. The mound system is to be inspected by the homeowner for leaks or saturated areas. Inspections are to be done every month for 36 months. Any leaks or failures in system must be reported to the county within 24 hours.

Any and all expenses are inspections, maintenance, or repair is the homeowner's responsibility.

I Jason Churchill, property owner of 3298 Velvet St. Hinckley MN.

Hereby agree that as long as I am the owner of the property, to accept all legal and financial responsibility for future system repair and/or replacement expense in the event that failure of the system on the above referenced property occurs.

Owner

Date



**Septic System Management Plan
for Above Grade Systems**

The goal of a septic system is to protect human health and the environment by properly treating wastewater before returning it to the environment. Your septic system is designed to kill harmful organisms and remove pollutants before the water is recycled back into our lakes, streams and groundwater.

This management plan will identify the operation and maintenance activities necessary to ensure long-term performance of your septic system. Some of these activities must be performed by you, the homeowner. Other tasks must be performed by a licensed septic maintainer or service provider. However, it is **YOUR** responsibility to make sure all tasks get accomplished in a timely manner.

The University of Minnesota's *Septic System Owner's Guide* contains additional tips and recommendations designed to extend the effective life of your system and save you money over time.

Proper septic system design, installation, operation and maintenance means safe and clean water!

Property Owner	JASON CHURCHILL	Email	
Property Address	3298 VELVET ST HINCKLEY MN.	Property ID	13.00030.00
System Designer	KEVIN HERWIG	Contact Info	320-241-7063
System Installer		Contact Info	
Service Provider/Maintainer		Contact Info	
Permitting Authority	KANABEC COUNTY	Contact Info	320-679-6456
Permit #		Date Inspected	

Keep this Management Plan with your Septic System Owner's Guide. The Septic System Owner's Guide includes a folder to hold maintenance records including pumping, inspection and evaluation reports. Ask your septic professional to also:

- Attach permit information, designer drawings and as-built of your system, if they are available.
- Keep copies of all pumping records and other maintenance and repair invoices with this document.
- Review this document with your maintenance professional at each visit; discuss any changes in product use, activities, or water-use appliances.


For a copy of the *Septic System Owner's Guide*, visit www.bookstores.umn.edu and search for the word "septic" or call 800-322-8642.

For more information see <http://septic.umn.edu>

Version: August 2015



Your Septic System

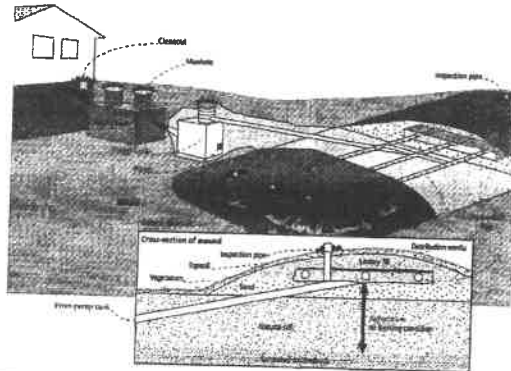

Septic System Specifics	
System Type: <input type="radio"/> I <input type="radio"/> II <input checked="" type="radio"/> III <input type="radio"/> IV* <input type="radio"/> V* (Based on MN Rules Chapter 7080.2200 - 2400) *Additional Management Plan required	<input type="checkbox"/> System is subject to operating permit* <input type="checkbox"/> System uses UV disinfection unit* Type of advanced treatment unit _____
Dwelling Type	Well Construction
Number of bedrooms: <u>3</u> System capacity/ design flow (gpd): <u>450</u> Anticipated average daily flow (gpd): <u>450</u> Comments _____ Business? : <input type="radio"/> Y <input checked="" type="radio"/> N What type? _____	Well depth (ft): <u>>55'</u> <input type="checkbox"/> Cased well Casing depth: <u>OVER 55'</u> <input type="checkbox"/> Other (specify): _____ Distance from septic (ft): <u>180</u> Is the well on the design drawing? <input checked="" type="radio"/> Y <input type="radio"/> N
Septic Tank	
<input type="checkbox"/> First tank Tank volume: <u>1600</u> gallons Does tank have two compartments? <input checked="" type="radio"/> Y <input type="radio"/> N <input type="checkbox"/> Second tank Tank volume: _____ gallons <input type="checkbox"/> Tank is constructed of CONCRETE <input type="checkbox"/> Effluent screen: <input checked="" type="radio"/> Y <input type="radio"/> N Alarm <input checked="" type="radio"/> Y <input type="radio"/> N	<input type="checkbox"/> Pump Tank _____ gallons <input type="checkbox"/> Effluent Pump make/model: <u>GOULDS WE0511H</u> Pump capacity <u>50</u> GPM TDH <u>20</u> Feet of head <input type="checkbox"/> Alarm location <u>HOME</u>
Soil Treatment Area (STA)	
Mound/At-Grade area (width x length): <u>42</u> ft x <u>74</u> ft Rock bed size (width x length): <u>10</u> ft x <u>38</u> ft Location of additional STA: _____ Type of distribution media: _____	<input checked="" type="checkbox"/> Inspection ports <input checked="" type="checkbox"/> Cleanouts <input type="checkbox"/> Surface water diversions <input type="checkbox"/> Additional STA not available



Homeowner Management Tasks

These operation and maintenance activities are your responsibility. Chart on page 6 can help track your activities.

Your toilet is not a garbage can. Do not flush anything besides human waste and toilet paper. No wet wipes, cigarette butts, disposal diapers, used medicine, feminine products or other trash!

The system and septic tanks needs to be checked every 36 months

Your service provider or pumper/maintainer should evaluate if your tank needs to be pumped more or less often.

Seasonally or several times per year

- **Leaks.** Check (listen, look) for leaks in toilets and dripping faucets. Repair leaks promptly.
- **Soil treatment area.** Regularly check for wet or spongy soil around your soil treatment area. If surfaced sewage or strong odors are not corrected by pumping the tank or fixing broken caps and leaks, call your service professional. *Untreated sewage may make humans and animals sick.* Keep bikes, snowmobiles and other traffic off and control borrowing animals.
- **Alarms.** Alarms signal when there is a problem; contact your service professional any time the alarm signals.
- **Lint filter.** If you have a lint filter, check for lint buildup and clean when necessary. If you do not have one, consider adding one after washing machine.
- **Effluent screen.** If you do not have one, consider having one installed the next time the tank is cleaned along with an alarm.

Annually

- **Water usage rate.** A water meter or another device can be used to monitor your average daily water use. Compare your water usage rate to the design flow of your system (listed on the next page). Contact your septic professional if your average daily flow over the course of a month exceeds 70% of the design flow for your system.
- **Caps.** Make sure that all caps and lids are intact and in place. Inspect for damaged caps at least every fall. Fix or replace damaged caps before winter to help prevent freezing issues.
- **Water conditioning devices.** See Page 5 for a list of devices. When possible, program the recharge frequency based on *water demand (gallons)* rather than *time (days)*. Recharging too frequently may negatively impact your septic system. Consider updating to demand operation if your system currently uses time.
- **Review your water usage rate.** Review the Water Use Appliance chart on Page 5. Discuss any major changes with your service provider or pumper/maintainer.

During each visit by a service provider or pumper/maintainer

- Make sure that your service professional services the tank through the manhole. (NOT through a 4" or 6" diameter inspection port.)
- Ask how full your tank was with sludge and scum to determine if your service interval is appropriate.
- Ask your pumper/maintainer to accomplish the tasks listed on the Professional Tasks on Page 4.



Professional Management Tasks

These are the operation and maintenance activities that a pumper/maintainer performs to help ensure long-term performance of your system. At each visit a written report/record must be provided to homeowner.

Plumbing/Source of Wastewater

- Review the Water Use Appliance Chart on Page 5 with homeowner. Discuss any changes in water use and the impact those changes may have on the septic system.
- Review water usage rates (if available) with homeowner.

Septic Tank/Pump Tanks

- *Manhole lid.* A riser is recommended if the lid is not accessible from the ground surface. Insulate the riser cover for frost protection.
- *Liquid level.* Check to make sure the tank is not leaking. The liquid level should be level with the bottom of the outlet pipe. (If the water level is below the bottom of the outlet pipe, the tank may not be watertight. If the water level is higher than the bottom of the outlet pipe of the tank, the effluent screen may need cleaning, or there may be ponding in the soil treatment area.)
- *Inspection pipes.* Replace damaged or missing pipes and caps.
- *Baffles.* Check to make sure they are in place and attached, and that inlet/outlet baffles are clear of buildup or obstructions.
- *Effluent screen.* Check to make sure it is in place; clean per manufacturer recommendation. Recommend retrofitted installation if one is not present.
- *Alarm.* Verify that the alarm works.
- *Scum and sludge.* Measure scum and sludge in each compartment of each septic and pump tank, pump if needed.

Pump

- *Pump and controls.* Check to make sure the pump and controls are operating correctly.
- *Pump vault.* Check to make sure it is in place; clean per manufacturer recommendations.
- *Alarm.* Verify that the alarm works.
- *Drainback.* Check to make sure it is draining properly.
- *Event counter or elapsed time meter.* Check to see if there is an event counter or elapsed time meter for the pump. If there is one or both, calculate the water usage rate and compare to the anticipated use listed on Design and Page 2. Dose Volume: _____ gallons: Pump run time: _____ Minutes

Soil Treatment Area

- *Inspection pipes.* Check to make sure they are properly capped. Replace caps and pipes that are damaged.
- *Surfacing of effluent.* Check for surfacing effluent or other signs of problems.
- *Lateral flushing.* Check lateral distribution; if cleanouts exist, flush and clean at recommended frequency.
- *Vegetation.* - Check to see that a good growth of vegetation is covering the system.

All other components – evaluate as listed here: _____



**Water-Use Appliances and
Equipment in the Home**

Appliance	Impacts on System	Management Tips
Garbage disposal	<ul style="list-style-type: none"> • Uses additional water. • Adds solids to the tank. • Finely-ground solids may not settle. Unsettled solids can exit the tank and enter the soil treatment area. 	<ul style="list-style-type: none"> • Use of a garbage disposal is not recommended. • Minimize garbage disposal use. Compost instead. • To prevent solids from exiting the tank, have your tank pumped more frequently. • Add an effluent screen to your tank.
Washing machine	<ul style="list-style-type: none"> • Washing several loads on one day uses a lot of water and may overload your system. • Overloading your system may prevent solids from settling out in the tank. Unsettled solids can exit the tank and enter the soil treatment area. 	<ul style="list-style-type: none"> • Choose a front-loader or water-saving top-loader, these units use less water than older models. • Limit the addition of extra solids to your tank by using liquid or easily biodegradable detergents. Limit use of bleach-based detergents and fabric softeners. • Install a lint filter after the washer and an effluent screen to your tank • Wash only full loads and think even – spread your laundry loads throughout the week.
Dishwasher	<ul style="list-style-type: none"> • Powdered and/or high-phosphorus detergents can negatively impact the performance of your tank and soil treatment area. • New models promote “no scraping”. They have a garbage disposal inside. 	<ul style="list-style-type: none"> • Use gel detergents. Powdered detergents may add solids to the tank. • Use detergents that are low or no-phosphorus. • Wash only full loads. • Scrape your dishes anyways to keep undigested solids out of your septic system.
Grinder pump (in home)	<ul style="list-style-type: none"> • Finely-ground solids may not settle. Unsettled solids can exit the tank and enter the soil treatment area. 	<ul style="list-style-type: none"> • Expand septic tank capacity by a factor of 1.5. • Include pump monitoring in your maintenance schedule to ensure that it is working properly. • Add an effluent screen.
Large bathtub (whirlpool)	<ul style="list-style-type: none"> • Large volume of water may overload your system. • Heavy use of bath oils and soaps can impact biological activity in your tank and soil treatment area. 	<ul style="list-style-type: none"> • Avoid using other water-use appliances at the same time. For example, don't wash clothes and take a bath at the same time. • Use oils, soaps, and cleaners in the bath or shower sparingly.
Clean Water Uses	Impacts on System	Management Tips
High-efficiency furnace	<ul style="list-style-type: none"> • Drip may result in frozen pipes during cold weather. 	<ul style="list-style-type: none"> • Re-route water directly out of the house. Do not route furnace discharge to your septic system.
Water softener Iron filter Reverse osmosis	<ul style="list-style-type: none"> • Salt in recharge water may affect system performance. • Recharge water may hydraulically overload the system. 	<ul style="list-style-type: none"> • These sources produce water that is not sewage and should not go into your septic system. • Reroute water from these sources to another outlet, such as a dry well, drainfile or old drainfield.
Surface drainage Footing drains	<ul style="list-style-type: none"> • Water from these sources will overload the system and is prohibited from entering septic system. 	<ul style="list-style-type: none"> • When replacing, consider using a demand-based recharge vs. a time-based recharge. • Check valves to ensure proper operation; have unit serviced per manufacturer directions



Homeowner Maintenance Log

Track maintenance activities here for easy reference. See list of management tasks on pages 3 and 4.

Activity	Date accomplished											
Check frequently:												
Leaks: check for plumbing leaks*												
Soil treatment area check for surfacing**												
Lint filter: check, clean if needed*												
Effluent screen (if owner-maintained)***												
Alarm**												
Check annually:												
Water usage rate (maximum gpd _____)												
Caps: inspect, replace if needed												
Water use appliances – review use												
Other:												

*Monthly

**Quarterly

***Bi-Annually

Notes:

****SEE MONITORING & MITIGATION PLAN****

"As the owner of this SSTS, I understand it is my responsibility to properly operate and maintain the sewage treatment system on this property, utilizing the Management Plan. If requirements in this Management Plan are not met, I will promptly notify the permitting authority and take necessary corrective actions. If I have a new system, I agree to adequately protect the reserve area for future use as a soil treatment system."

Property Owner Signature: _____

Date _____

Management Plan Prepared By: KEVIN HERWIG

Certification # 3659

Permitting Authority: KANABEC COUNTY



This Page Intentionally Left Blank

**CONSTRUCTION OF SANITATION FACILITIES
FOR
EXISTING HOMES
AT
SCATTERED SITES
ON THE
MILLE LACS INDIAN RESERVATION
MILLE LACS, KANEPEC, AITKIN, AND PINE COUNTIES, MINNESOTA
PROJECT BE 17-L02
Jason Churchill
DRAWINGS AND SPECIFICATIONS**

**U.S. DEPARTMENT OF HEALTH AND HUMAN SERVICES
PUBLIC HEALTH SERVICE
INDIAN HEALTH SERVICE
OFFICE OF ENVIRONMENTAL HEALTH
AND ENGINEERING
BEMIDJI AREA OFFICE**

SPECIFICATION INDEX

<u>SECTION NUMBER</u>	<u>TITLE</u>
01100	Summary of Work
01270	Price and Payment
01310	Project Management and Coordination
01330	Submittal Procedure
01420	References
01430	Quality Assurance
01500	Temporary Facilities and Controls
01770	Closeout Procedures
01780	Closeout Submittals
02310	Grading
02315	Excavation, Trenching, and Backfill
02370	Temporary Erosion and Sediment Control
02541	Pressure Dosed Mound System
02545	Concrete Septic Tank and Piping
02920	Topsoiling, Seeding, Fertilizing, and Mulching

**SECTION 01100
SUMMARY OF WORK**

PART 1 - GENERAL

1.01 SUMMARY

- A. The work to be performed under this contract shall consist of furnishing the following to perform the work outlined in these specifications and as indicated by Project Drawings:
 - 1. tools
 - 2. equipment
 - 3. materials
 - 4. labor
 - 5. supplies
 - 6. manufactured articles
 - 7. all transportation to complete the work
 - 8. temporary facilities

- B. Location of Work: 3298 Velvet Street, Hinkley, Pine County, Minnesota, for the Mille Lacs Band of Ojibwe

- C. Incidentals Items: All work, materials, and services not expressly listed as being provided by others or not expressly called for in the contract but are necessary for the completion of the work in good faith, shall be furnished, installed, and performed by the contractor.

1.02 SUMMARY OF WORK TO BE DONE BY CONTRACTOR

- A. Individual Wastewater Facilities
 - 1. Install Septic Tanks, Pump Tank and Mound System per design, drawing and specifications.
 - 2. Abandon Existing Septic Tank and Existing Mound System per design drawing and specifications.
 - 3. Acquire ISTS Permit

1.03 ADDITIONAL INFORMATION

- A. For information regarding contracting information, contact the Owner's Representative for this project:

Brian Scheinost
Public Works Administrator
Mille Lacs Public Works
43408 Oodena Drive
Onamia, MN 56359
Telephone: (320) 532-7437

- C. Comply with all Tribal regulations related to the completion of the work including the acquisition of necessary permits and the payment of Tribal taxes.

1.04 WARRANTY

- A. Provide a minimum one (1) year warranty for all materials and labor, covering defects in the materials or deficiencies resulting from Contractor installation and materials.

1.05 ADDITIONAL REQUIREMENTS

- A. Contractor shall be licensed and insured.

END OF SECTION

**SECTION 01270
PRICE AND PAYMENT**

PART 1 - GENERAL

1.01 SUMMARY

- A. Work covered by this section includes method of measurement and basis of payment for all divisions included.
- B. Payment for the various items of the Bid Schedules, as further specified herein, shall include all compensation to be received by the Contractor for furnishing all tools, equipment, materials, labor, supplies, manufactured articles, transportation, and temporary facilities required to complete the work in accordance with contract documents including incidentals.
- C. Respective prices and payment shall constitute full compensation for all work completed including incidentals.
- D. All items not expressly listed as being provided by others that are necessary for the completion of work shall be furnished and installed by the Contractor.
- E. No payment shall be made for mobilization and demobilization of equipment.

1.02 ESTIMATED QUANTITIES

- A. All quantities stipulated in the bid schedule or other contract documents are approximate and are to be used: (1) as a basis for estimating the probable cost of the work and (2) for the purpose of comparing the bids submitted.
- B. The Contractor shall be paid for actual quantities installed based on the quantities measured in the field. The actual amounts of work completed and materials furnished may differ from estimated quantities. The Contractor shall make no claim for damages, anticipated profits, or otherwise, on account of differences between the estimated amounts and the actual amount of work performed and materials furnished.

1.03 SURVEY AND MEASUREMENTS

- A. All quantity measurements shall be the responsibility of the Contractor and will be verified by the Engineer.
- B. All measurements and subsequent payments will be based on completed and accepted work performed in strict accordance with the drawings, specifications, and other contract documents.

PART 2 – BID SCHEDULE ITEMS

2.01 GENERAL

- A. Payment shall be full compensation to complete the work items in good faith, including incidental work.
- B. In addition to the those things listed under each item, the unit price bid shall be full compensation for all of the following:
 - 1. General requirements in Division 01, but not limited to the following.
 - a. Submittals
 - b. Record drawings
 - 2. Specific requirements in Division 02, including but not limited to the following (unless otherwise expressly defined as a line item in the bid schedule):
 - a. Erosion control
 - b. Clearing and grubbing
 - c. Removal and replacement of obstructions
 - d. Associated trenching, excavation and backfill including the removal of any nuisance water, bedding, haunching, and compaction.
 - e. Disposal of any excess material
 - f. Traffic control
 - g. Rough grading
 - h. Finish work, where called for, including finish grading, topsoiling, and landscaping

2.02 BID ITEMS

- A. Individual Wastewater Facilities Design
 - 1. 1600 Gallon Septic Tank
 - a. Measurement: Per each tank installed.
 - b. Basis for Payment: Payment shall be full compensation for septic tank, fittings, risers, connections, excavation, compaction, grading, and site restoration.
 - 2. 1250 Gallon Pump Tank
 - a. Measurement: Per each tank installed

- b. Basis for Payment: Payment shall be full compensation for pump tank, fittings, risers, connections, excavation, compaction, grading, and site restoration
- 3. 4-Inch Solid PVC Pipe:
 - a. Measurement: Per linear foot,
 - b. Basis for Payment: Includes pipe, fittings, connections, excavation, trenching, bedding, haunching, backfill, compaction, grading, and site restoration.
- 4. Two-way Cleanout:
 - a. Measurement: By each unit installed.
 - b. Basis for Payment: Includes pipe, fittings, covers, connections, excavation, trenching, bedding, haunching, backfill, compaction, grading, and site restoration.
- 5. Effluent Pump with Controls:
 - c. Measurement: By each unit installed.
 - d. Basis for Payment: Includes pump, control, alarm system, float switches, above ground electrical wiring, in-chamber piping, union, fittings and connections.
- 6. Electrical Cable:
 - a. Measurement: Per linear foot.
 - b. Basis for Payment: Payment shall be full compensation for cable, splices, conduit, excavation, trenching, bedding, backfill, compaction, grading, and site restoration.
- 7. 2-inch Solid PVC Effluent Pipe:
 - a. Measurement: Per linear foot.
 - b. Basis for Payment: Payment shall be full compensation for pipe, fittings, connections, excavation, trenching, bedding, haunching, backfill, compaction, grading, and site restoration.
- 8. Mound System Constructed on Existing Mound Site:
 - a. Measurement: Lump Sum for the complete mound system.

- b. Basis for Payment: Payment shall be full compensation for a complete and operational mound system per the design and specifications. This includes removal of all existing piping, rock, sand, loam cover topsoil and debris above the original rough in, installation of new clean sand material, loam fill, topsoil, gravel synthetic material and placement, plowing of the original topsoil, removing excessive vegetation, manifold piping, perforated pipe, seeding, protective cover for seeding, observation pipes and all other incidentals.

- 9. ISTS Permit:
 - a. Measurement: Per each permit obtained.
 - b. Basis for Payment: Payment includes site evaluation, permit application, and permit fee submitted to appropriate local authority.

- 10. Abandon Existing Tank:
 - a. Measurement: Lump Sum for the abandoned septic tank.
 - b. Basis for Payment: Payment shall be full compensation for all work necessary to properly abandon the existing septic tank per state code.

PART 3 – EXECUTION (N/A)

END OF SECTION

**SECTION 01310
PROJECT MANAGEMENT AND COORDINATION**

PART 1 - GENERAL

1.01 SUMMARY

- A. Section includes the preconstruction conference, construction scheduling and coordination requirements.

1.02 PRE-CONSTRUCTION CONFERENCE

- A. Required after award of contract and prior to start of construction.
- B. Representatives from the following shall attend.
 - 1. Prime Contractor
 - 2. Subcontractors
 - 3. Engineer and Technical Representative
 - 4. Owner's Representative
- C. Engineer will arrange a date that is mutually acceptable to all parties planning to attend.
- D. Contractor shall notify subcontractors of time and date of meeting.

1.03 CONSTRUCTION SCHEDULE

- A. Present Owner and Engineer with a written preliminary construction schedule containing start and completion dates of the major items at the preconstruction meeting.
- B. Notify the Owner and Engineer seven (7) days in advance of any construction.
- C. Communicate major changes to the schedule to the Owner and Engineer in writing.

1.04 WORKING HOURS/DAYS

- A. Except as required for safety purposes, all work shall be performed during regularly scheduled working hours. The Contractor shall not work on Saturday, Sunday, or a Federal holiday without the Owner and Engineer's consent.

1.05 COORDINATION WITH OTHER CONTRACTORS/UTILITIES

- A. Coordinate work with other contractors (i.e. roads, building, etc.) in the area as necessary to complete the work specified.

- B. Coordinate work with local utilities (i.e. water and sewer, power, telephone).
Note: all buried utilities may not be shown on the plans. Contractor's responsibility for having utilities marked prior to construction.

END OF SECTION

SECTION 01330 SUBMITTAL PROCEDURE

PART 1 - GENERAL

1.01 SUMMARY

- A. This section includes information on submittal procedures. Materials requiring submittal are listed in the appropriate specification section.

1.02 SUBMITTAL PROCEDURES

- A. Submit copies of submittals to the Engineer, unless requested otherwise.
 - 1. Contractor's option:
 - i. Two (2) hard copies.
 - ii. An electronic copy in pdf format delivered to Engineer via email or other means as approved by the Engineer.
- B. Identify each cut sheet or shop drawing with the following information:
 - 1. Contract number.
 - 2. Supplier.
 - 3. Specification section to which the submittal pertains.
- C. Submit the following information, as applicable:
 - 1. Manufacturer's cut sheets indicating compliance with references (e.g. applicable ASTM, AWWA standards).
 - 2. Laboratory results, as applicable.
 - 3. Dimensional drawings or shop drawings, as applicable.
 - 4. Other information necessary for the Engineer to determine compliance with the specifications.
 - 5. Clearly identify brand, manufacturer, model number, sizes, and all other information on each cut sheet to identify the exact product being submitted for approval.
- D. Identify variations from the contract documents and product or system limitations that may be detrimental to successful performance of the completed work.
- E. Revise and resubmit submittals as required and identify all changes made since previous submittal.
- F. Distribute copies of reviewed submittals to concerned parties, (i.e. suppliers, sub-contractors).

- G. Submit written communication of any inability to comply with the Engineer's comments.
- H. Submit information to the Engineer at least three weeks in advance of the work to be performed.
- I. Approval of submittals must be provided by the Engineer prior to installation of materials.

END OF SECTION

SECTION 01420 REFERENCES

PART 1 - GENERAL

1.01 SUMMARY

- A. This section includes a list of common organizations, associations or appropriate agencies with jurisdiction that have references, standards, laws or regulations cited in these specifications. This list is not all-inclusive. Other agencies (county, local, tribal) with jurisdiction might not be listed here.
- B. Use latest revision of all references, standards, laws or regulations.

1.02 LIST OF ORGANIZATIONS, ASSOCIATIONS & AGENCIES

A. National Standards Organizations & Associations

American Association of State Highway and
Transportation Officials (AASHTO)
444 North Capital Street NW, Suite 249
Washington DC, 20001
(202) 624-5800
www.aashto.org

American Concrete Institute (ACI)
ACI International
PO Box 9094
Farmington Hills, Michigan 48333-9094
(810) 848-3700
www.aci-int.org

American Society for Testing and Materials
(ASTM)
100 bar Harbor Drive
West Conshohocken, Pa 19428-2959
(610) 832-9585
www.astm.org

American Water Works Association AWWA
6666 West Quincy Avenue
Denver, CO 80235
(303) 794-7711
www.awwa.org

National Electric Code (NEC)
National Fire and Protection Association
1 Batterymarch Park
Quincy, MA 02269-9959
1 888 632-2633
www.nec.com

National Electrical Manufacturer's Association
NEMA
1300 North 17th Street
Rosslyn, VA 22209
(703) 841-3200
www.nema.org

Underwriters' Laboratories, Inc. UL
333 Pfingston Road
Northbrook, IL 60062
(847) 272-8800
www.ul.com

B. Federal Agencies

Environmental Protection Agency (EPA)
Region 5
77 West Jackson
Chicago, IL 60604-3507
<http://www.epa.gov/r5water/>

Occupational Health and Safety Administration
Region 5 (OSHA)
238 South Dearborn Street , Room 3244
Chicago, IL 60604
www.osha.gov

C. State Agencies

Minnesota Department of Transportation
(MNDOT)
Transportation Building
395 John Ireland Boulevard
St. Paul, MN 55155
1 800 651-3774
www.dot.state.mn.us

Minnesota Pollution Control Agency (MPCA)
Individual Sewage Treatment System Standard
520 Lafayette Road
St Paul, MN 55155
1 800 657-3864
www.pca.state.mn.us

Minnesota Department of Health
717 Delaware Street South East
Minneapolis, MN 55440-9441
(651) 201-5000
www.health.state.mn.us

D. Local Agencies

1. Contractor shall review other local agency requirements to determine applicability with this project.

E. Tribal Organizations

1. See Section 01100 for appropriate tribal contact regarding tribal laws.

PART 2 – PRODUCTS (N/A)

PART 3 – EXECUTION (N/A)

END OF SECTION

**SECTION 01430
QUALITY ASSURANCE**

PART 1 - GENERAL

1.01 SUMMARY

- A. This section includes prerequisites and procedures to assure the quality of construction.

1.02 SUBMITTALS

- A. Contractor Name and License Number

1.03 INSTALLER QUALIFICATIONS

- A. Work shall be performed under the direction of personnel licensed in the state/reservation where the project is proposed and where licensing of the trade is regulated by the state/reservation including, but not limited to, plumbing, well drilling, septic system installation, HVAC, and electrical work.

1.04 CONTROL OF INSTALLATION

- A. Review materials for acceptability when delivered to the site.
- B. Store and handle materials to prevent damage.
- C. Review materials, services, and workmanship to ensure that work is performed in accordance with the specifications.
- D. Comply fully with manufacturers' instructions.
- E. Should manufacturers' instructions conflict with contract documents, request clarification from Engineer before proceeding.
- F. Correct defective work to the satisfaction of the Project Engineer.

1.05 MANUFACTURER'S FIELD SERVICES

- A. Provide reports on observations and documentation of workmanship to the Engineer within 30 days of visit for review where manufacturers' field services are provided.

1.06 WARRANTY

- A. Provide a minimum one (1) year warranty for all materials and labor, covering defects in the materials or deficiencies resulting from contractor installation.
- B. Provide additional warranties as required under other sections.

END OF SECTION

**SECTION 01500
TEMPORARY FACILITIES AND CONTROLS**

PART 1 - GENERAL

1.01 SUMMARY

- A. The work covered by this section includes all temporary facilities and controls needed to complete work under the Contract in a manner that protects public safety and worker safety, that preserves both public and private property and that appropriately involves local governments, emergency and law enforcement.

1.02 RELATED WORK

- A. Section 02315 – Excavation, Trenching and Backfill
- B. Section 02705 – Road Restoration

1.03 REFERENCES

- A. Manual on Uniform Traffic Control Devices

PART 2 – PRODUCTS (NOT APPLICABLE)

PART 3 - EXECUTION

3.01 GENERAL

- 1. Provide temporary facilities and controls that are necessary to carry out the requirements of the Contract in a manner
 - 1. That protects public safety and worker safety
 - 2. That preserves both private and public property
 - 3. That communicates and cooperates with local authorities and governments.

3.02 TEMPORARY WATER (IF APPLICABLE)

- A. If there is an existing building or hydrant on the site from which water can be taken, Contractor may use the available water if authorized by the Owner.
- B. If the Owner has water supply mains, but no hydrant is available, Contractor may make a water main tap and create a service line if authorized by the Owner.

- C. If the Owner does not have a water supply, make arrangements to obtain water and pay for it at no direct cost to the project.
- D. Cross Connection Control: When connecting to the Owner's water supply, provide appropriate backflow prevention devices in accordance with State codes and the Owner's requirements.

3.03 TEMPORARY SANITARY FACILITIES

- A. Provide and maintain a chemical toilet approved by the State Department of Health (MN) for the use of all workers of all trades.
- B. Place temporary facilities in an inconspicuous place and keep clean.
- C. Remove temporary sanitary facilities after completion of the project.

3.04 BARRICADES & WARNING DEVICES

- A. Notify local police, fire departments and other emergency programs of any proposed barricading or detouring.
- B. Erect and maintain barricades, guardrails, lights and signs as necessary for public convenience and safety.
- C. Ensure that barricades remain in place during critical hours.
- D. Comply with "Occupational Safety and Health Act" and local safety requirements, as they apply.

3.05 TRAFFIC CONTROL

- A. Conduct all traffic control operations in accordance with the latest issues of the "Manual On Uniform Traffic Control Devices" (MUTCD).
- B. Coordinate and obtain approval for all traffic control from local law enforcement.
- C. Signs, Signals and Devices
 - 1. Place warning signs in the region of the work.
 - 2. Warn of types of conditions that may be encountered.
 - a. Muddy Roads
 - b. Slippery Roads
 - c. Flagger
 - d. Detour
 - e. Slow Moving Traffic
 - f. Trucks Entering Roadway

3. Traffic Control Signals: Meet the needs of the local government authority.
4. Traffic Cones and Drums, Flares and Lights:
 - a. Meet the needs of the local jurisdictions.
 - b. Use flares and lights during hours of low visibility to delineate traffic lanes and to guide traffic.
 - c. Ensure that flares, lights, etc. remain in position throughout the night.
5. Flagman:
 - a. Meet the needs of the local jurisdictions.
 - b. Provide trained and equipped flagmen to regulate traffic when construction operations or traffic encroach on public traffic lanes.

C. Haul Routes:

1. Consult with authority having jurisdiction in establishing public thoroughfares to be used for haul routes and site access.
2. Confine construction traffic to designated haul routes.
3. Provide traffic control at critical areas of haul routes to regulate traffic, to minimize interference with public traffic.

D. Removal of Traffic Control:

1. Remove equipment and devices when no longer required.
2. Repair damage caused by installation.

3.06 ACCESS ROADS

- A. Construct and maintain temporary roads accessing public thoroughfares to serve construction area.
- B. Provide detours necessary for unimpeded traffic flow.
- C. Provide and maintain access to fire hydrants, free of obstructions.
- D. Permanent access roads and parking areas, if applicable, will be covered in Division 2, Site Work.

3.07 PARKING

- A. If the site is large enough, the Contractor may park their own and employees' vehicles on the site without charge after obtaining permission from the Owner.
- B. If the site is not large enough, the Contractor shall make parking arrangements.
- C. Prevent interference with the flow of local traffic.
- D. Prevent interference with emergency vehicle functions.

3.08 ROAD SURFACE MAINTENANCE

- A. Remove mud and excavated spoils from the affected roadway at the end of each workday in order to preserve the roadways and maintain safe driving conditions.
- B. Contractor is responsible for any costs associated with repairing the roadways that are damaged due to construction equipment.

3.09 WATER CONTROL

- A. Grade site to drain.
- B. Protect site from puddling or running water.
- C. Provide water barriers as required to protect site from soil erosion.

3.10 DUST CONTROL

- A. Use measures to minimize dust caused by the project.
- B. Avoid dust-creating activities during dry, windy conditions.

3.11 SECURITY

- A. The Owner will **not** be responsible for security on the site of work.
- B. Each Contractor will be held responsible for loss or injury to persons or property where their work is involved.
- C. Provide (if deemed necessary) such watchmen and take such other precautionary measures as deemed necessary to protect facilities during the contract period.

3.12 PROGRESS CLEANING

- A. Maintain areas free of waste materials, debris and rubbish. Maintain site in a clean and orderly condition.
- B. Remove waste materials, debris, and rubbish from site weekly and dispose off-site.

3.13 REMOVAL OF UTILITIES, FACILITIES & CONTROLS

- A. Remove temporary above grade or buried utilities, equipment, facilities, materials, prior to inspection.
- B. Clean and repair damage caused by installation or use of temporary work.
- C. Restore existing facilities used during construction to original condition.

3.14 TEMPORARY FIRST AID FACILITIES

- A. Provide temporary first aid facilities for employees in sufficient quantity for the number of workers.

3.15 TEMPORARY FIRE PROTECTION

- A. Post fire department telephone numbers at the jobsite.
- B. Keep fire extinguishers on the job that are appropriate for the type of work being performed.

3.16 TEMPORARY PROJECT SIGNAGE

- A. Construct project signage to the specifications as shown in template.
- B. Install project signage at the locations indicated on the plans or as approved by the Engineer.

END OF SECTION



This Page Intentionally Left Blank

**SECTION 01770
CLOSEOUT PROCEDURES**

PART 1 - GENERAL

1.01 SUMMARY

- A. Section includes information on closeout procedures and final cleaning.

1.02 RELATED WORK

- A. Section 01780 – Closeout Submittals

1.03 CLOSEOUT PROCEDURES

- A. Submit written certification that work is complete in accordance with contract documents and ready for final inspection at least three (3) working days prior to final inspection.
- B. Provide warranties and record documents (e.g. as-built drawings) to the Engineer that are required within ten (10) days after date of first beneficial use. Refer to Section 01780.

1.04 FINAL CLEANING

- A. Complete final clean-up prior to final inspection.
- B. Remove waste and surplus materials, rubbish, and construction facilities from the site.

1.05 FINAL INSPECTION

- A. A final inspection of the facilities shall be conducted in the presence of the Owner, the Engineer, and the Contractor, at a minimum.
- B. Final inspection shall include inspection of all facilities installed under the project.

1.06 PUNCH LIST

- A. Any deficiencies noted at the Final Inspection will be communicated to the Contractor through a letter from the Engineer.
- B. All deficiencies will need to be completed before full payment is made.
- C. Retainage for punch list items shall be based on the estimated cost to retain another contractor to finish the deficient work items.

END OF SECTION



This Page Intentionally Left Blank

**SECTION 01780
CLOSEOUT SUBMITTALS**

PART 1 - GENERAL

1.01 SUMMARY

- A. This section describes the requirements for closeout submittals including, record drawings, warranty information and general operation and maintenance information.

1.02 RELATED WORK

- A. Section 01430 – Quality Assurance
- B. Section 01770 – Closeout Procedures

1.03 DELIVERY

- A. Provide all closeout submittals meeting these requirements and any specific requirements of each section.
- B. Closeout submittals must be received before payment is requested for the work that the drawings describe or illustrate.
- C. All closeout submittals must be received in a correct and complete manner before final payment can be made. If material is deficient, the deficiencies will be indicated in punch lists (Section 01770).

1.04 DEFINITIONS

- A. Record Drawing: A drawing showing the actual installation of facilities, showing changes from the plans, and showing detail enough that future persons can readily locate all objects.
- B. Ties: Measurements from permanent easily located objects to an installed object.

PART 2 – PRODUCTS (NOT APPLICABLE)

PART 3 - EXECUTION

3.01 RECORD DRAWINGS

- A. Provide record data in one of the following manners:
 - 1. On a set of project drawings, neatly draw tie measurements and changes.

2. On separate 8½ X 11 sheets (see 01780D – Closeout Submittal Drawings), neatly draw site sketches, structure sketches, etc., indicating the necessary information.
- B. Provide three (3) swing tie measurements to all buried utility objects that may need to be located in the future, including, but not limited to:
1. Gate valves
 2. Corporation stops
 3. Curb stops
 4. Water main fittings
 5. Couplings to existing water systems.
 6. Cleanouts
 7. Sewer wyes.
 8. Utility crossings.
 9. Septic tank manholes and access covers.
 10. Corners of drainfields
 11. Tracer Wire Boxes
- C. Provide offset measurements for buried utilities (e.g. water main) installed parallel to roads.
- D. Provide revised elevation data for all items that have elevations shown on the plan drawings, including, but not limited to, the following:
1. Manhole inverts (inlet and outlet)
 2. Manhole rims
 3. Lift station invert
 4. Lift station top
 5. Lift station pipe penetrations
 6. Float elevations
 7. Septic tank elevations
 8. Elevations of pipe entering and leaving structures
 9. Elevation of sewer service line stub (if terminated at right of way)
 10. Other elevations indicated on profiles.
- E. Provide installed bid schedule items quantities for individual facilities on 8½ X 11 sheets.
1. Engineer may supply standard forms for use by the Contractor.

3.02 WARRANTIES

- A. Submit all warranty information regarding the materials installed.
- B. Minimum warranty information is listed in Section 01430.

3.03 OPERATION AND MAINTENANCE INFORMATION

- A. Submit all operation and maintenance information as included in the packaging from the manufacturer regarding the materials installed.
- B. Additional project specific operation and maintenance requirements are listed in Section 01785.

END OF SECTION



This Page Intentionally Left Blank

SECTION 02310 GRADING

PART 1 - GENERAL

1.01 SUMMARY

- A. This section includes rough and finished site grading of all areas disturbed during construction.

1.02 RELATED WORK

- A. Section 02315 – Excavation, Trenching and Backfill
- B. Section 02370 – Temporary Erosion and Sediment Control
- C. Section 02920 – Topsoiling, Seeding, Fertilizing and Mulching

PART 2 – PRODUCTS (Not applicable)

PART 3 - EXECUTION

3.01 ROUGH GRADING

- A. Grade the area in the vicinity of the excavation to prevent surface water from flowing into the excavation.
- B. Maintain existing drainage.

3.02 FINISH GRADING

- A. Grade site to true grades as specified on the plans after all structures and piping have been installed.
- B. Grade sites for effective drainage away from structures.
- C. Dress and trim all slopes.

END OF SECTION



This Page Intentionally Left Blank

**SECTION 02315
EXCAVATION, TRENCHING, AND BACKFILL**

PART 1 - GENERAL

1.01 SUMMARY

- A. This section includes excavation, trenching and backfill necessary for the construction of the facilities as indicated on the plans including, but not limited to: water mains and service lines, sewer mains and service lines, concrete manholes, septic tanks, and other structures.

1.02 RELATED WORK (as applicable)

- A. Section 01720 – Staking and Construction Surveying
- B. Section 01780 – Closeout Submittals
- C. Section 02310 – Grading
- D. Section 02317 – Structural Fill
- E. Section 02370 – Temporary Erosion And Sediment Control
- F. Section 02511 – Water Service Lines
- G. Section 02530 – Sanitary Sewer
- H. Section 02532 – Sanitary Sewer Manholes
- I. Section 02538 – Sewage Force Main
- J. Section 02920 – Topsoiling, Seeding, Fertilization and Mulching

1.03 REFERENCES


- A. Manual on Uniform Traffic Control Devices.
- B. ASTM D698 – Test Methods for Moisture Density Relations of Soils and Soil-Aggregate Mixtures Using 5.5 lb. Rammer and 12-in. Drop [Standard Proctor Test].
- C. ASTM D2321 – Underground installation of Flexible Thermoplastic Sewer Pipe.
- D. ASTM D2487 – Classification of Soils for Engineering Purposes [Unified Soil Classification System].
- E. OSHA – Occupational Safety and Health Standards 1910 and 1926.

1.04 SUBMITTALS

- A. Polystyrene Insulation
- B. Polyethylene Encasement (as applicable)

1.05 DEFINITIONS

- A. Bedding, Haunching and Initial Backfill zones as defined herein and on the standard pipe trench detailed drawing below:

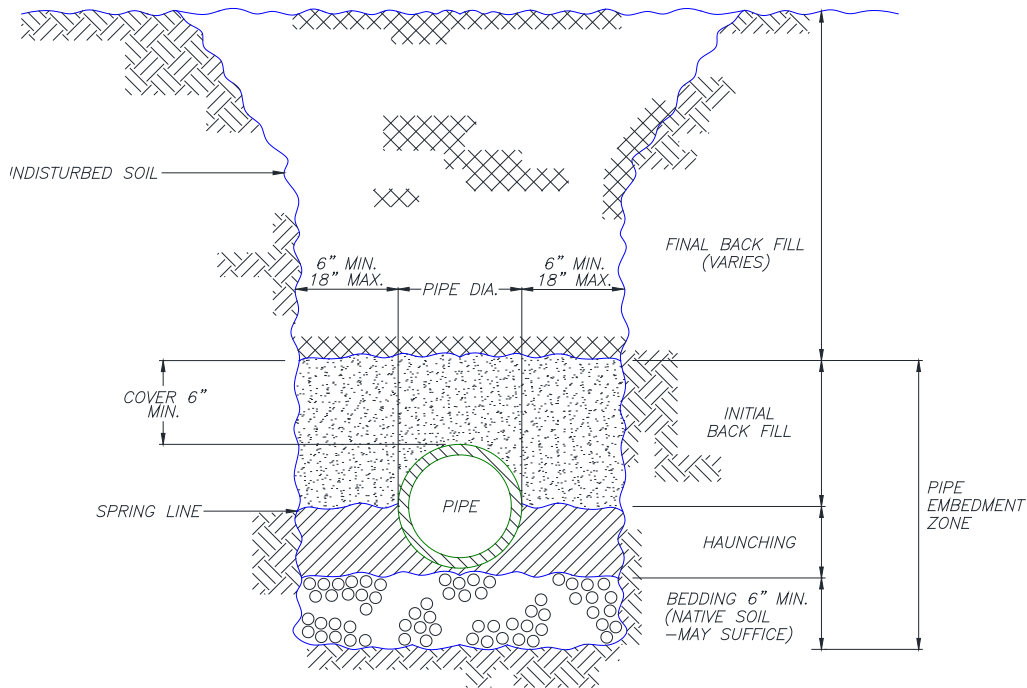

PIPE TRENCH DETAIL

- B. Soil Materials as summarized in the table below and defined in ASTM D2321 and ASTM D2487

Description and Comparison of Soil Material Classifications

ASTM D2321		ASTM D2487	
Class	Type	USCS Group Symbol	Description
IA	Manufactured aggregates: ¼ to 1 ½ inch open graded, clean.	* None	Closest to "Poorly graded gravel (GP)"
IB	Manufactured aggregates: ¼ to 1 ½ inch dense graded, clean.	* None	Closest to "Poorly graded gravel with sand (GP)"
II	Coarse sands and gravels with maximum particle size of 1 ½ inch, clean.	GW	Well-graded gravels and gravel-sand mixtures; little or no fines.
		GP	Poorly graded gravels and gravel sand mixtures; little or no fines.
		SW	Well-graded sands and gravelly sands; little or no fines.

		SP	Poorly graded sands and gravelly sands; little or no fines
	Coarse sands and gravels with maximum particle size of 1 ½ inch, borderline clean.	GW-GC SP-SM Etc.	Sands and gravels which are borderline between clean and with fines
III	Fine sand and clayey gravels.	GM	Silty gravels, gravel-sand-silt mixtures.
		GC	Clayey gravels, gravel-sand-clay mixtures
		SM	Silty sands, sand-silt mixtures
		SC	Clayey sands, sand-clay mixtures
IV	Fine grained soils (inorganic)	ML	Inorganic silts and very fine sands, rock flour, silty or clayey fine sands, silts with slight plasticity.
		CL	Inorganic clays of low to medium plasticity, gravelly clays, sandy clays, silty clays, lean clays.
		MH	Inorganic silts, micaceous or diatomaceous fine sandy or silty soils, elastic silts.
		CH	Inorganic clays of high plasticity, fat clays.
V	Organic soils	OL	Organic silts and organic silty clays of low plasticity.
		OH	Organic clays of medium to high plasticity, organic silts.
		PT	Peat and other high organic soils.

* USCS system is limited to naturally occurring soils. Manufactured aggregates not covered.

PART 2 – PRODUCTS

2.01 BEDDING, HAUNCHING AND INITIAL BACKFILL MATERIAL

- A. Class I, Class II or Class III, utilized in accordance with restrictions described in Part 3 - Execution.

2.02 INSULATION

- A. Rigid extruded polystyrene insulation board, having a minimum compressive strength of 25 psi.
- B. Width:
1. 4-foot for mains 6-inch (nominal diameter) and larger.
 2. 2-foot for mains and service lines less than 6-inches (nominal diameter).
- C. Thickness: As stipulated on the bid schedule.

2.03 POLYETHYLENE ENCASEMENT

- D. Minimum 8 mils thickness.

PART 3 - EXECUTION

3.01 GENERAL

- A. Trenching and excavation work shall be done in accordance with proper emphasis on safety as determined by the Contractor to conform to recommended safety standards such as OSHA 1910 and 1926.
- B. Obtain all permits from appropriate road agency for construction within road right of way.
- C. Repair damage resulting from settlement, slides, cave-ins, water pressure, and other causes.
- D. Provide adequate signs, barricades, fences and amber lights and take all necessary precautions to protect the work and the safety of the public in all construction areas.
 - 1. Placement of construction signs and barricades shall conform to the "Manual on Uniform Traffic Control Devices."
 - 2. Protect barricades and obstructions at night by amber signal lights that burn from sunset to sunrise. Barricades shall also be of substantial construction, painted white or with reflective paint to increase their visibility at night.
 - 3. Perform work without obstruction to traffic or inconvenience to the general public and the residents in the vicinity of the work.
- E. Road Crossing
 - 1. Comply with all construction and material requirements of roadway authorities having jurisdiction.
 - 2. Maintain one lane of traffic open at all times.
 - 3. Refer to Section 02705 – Road Restoration for backfill and restoration requirements.

3.02 EXCAVATION

- A. Remove trees and stumps from excavation and site.
- B. Remove and stockpile existing topsoil.
- C. Install facilities as staked unless otherwise approved by Engineer.

- D. Maintain surface drainage away from trenching or excavation.
- E. Remove unsuitable foundation materials from excavation as shown on the plans or as authorized by the Engineer.
- F. Maintain a minimum 1-foot clearance between outer surface of structure being installed and wall of excavation.
- G. Rock encountered shall be classified, excavated and measured in accordance with Section 02316 – Rock Excavation

3.03 TRENCHING

- A. Bottom width: No less than 12 inches or more than 36 inches wider than the outside diameter of the pipe.
- B. Depth: Provide minimum cover as specified, or depths shown on plans.

3.04 BEDDING

- A. If existing soil cannot provide uniform, stable bearing support, over-excavate 6 inches below bottom of pipe or structure and provide bedding material.
- B. Utilize Class I, II or III materials as appropriate for bedding as listed in Table below.

Use of Soils and Aggregate for Bedding

	<i>Class IA</i>	<i>Class IB</i>	<i>Class II</i>	<i>Class III</i>
General	Excellent pipe support. Excellent drainage.	Excellent pipe support. Good drainage. Minimizes migration of adjacent material.	Good pipe support. Fair drainage.	Reasonable pipe support. Poor drainage
Compaction	Not required	Not required	Required 90% of Standard Proctor.	Required 90% of Standard Proctor.
Wet Conditions (below current or future water table). Rock Cuts	Acceptable. Must use same material for Haunching.	Acceptable. Must use same material for Haunching.	Acceptable. Clean groups only suitable for drainage blanket.	Not- Acceptable
Dry Conditions	Acceptable	Acceptable	Acceptable	Acceptable

3.05 HAUNCHING AND INITIAL BACKFILL

- A. General
 - 1. Provide complete and uniform bearing and support for the pipe, including allowance for bell holes, or structure.

2. Work material under and around the pipe to ensure full pipe support.
 3. Prevent movement of the pipe during placement of material.
 4. Avoid contact between the pipe and mechanical compaction equipment.
- B. Utilize Class I, II or III materials as appropriate for haunching and initial backfill as listed in Table below. No frozen materials or frozen clods.

Use of Soils and Aggregate for Haunching and Initial Backfill

	<i>Class IA</i>	<i>Class IB</i>	<i>Class II</i>	<i>Class III</i>
General	Excellent pipe support. Excellent drainage. Install to a minimum of 6" above the pipe crown.	Excellent pipe support. Good drainage. Minimizes migration of adjacent material. Install to a minimum of 6" above the pipe crown.	Good pipe support. Fair drainage. Install and compact to a minimum of 6" above the pipe crown.	Reasonable pipe support. Poor drainage. Install and compact to a minimum of 6" above the pipe crown.
Compaction	Not required	Not required	Required 85% of Standard Proctor. 6 inch maximum lifts.	Required 90% of Standard Proctor. 6 inch maximum lifts.
Wet Conditions (below current or future water table). Rock Cuts	Acceptable. Must use same material for Bedding. Extend Haunching to the top crown of the pipe.	Acceptable. Must use same material for Bedding. Extend Haunching to the top crown of the pipe.	Acceptable. Clean groups only suitable for drainage.	Not- Acceptable
Dry Conditions	Acceptable	Acceptable	Acceptable	Acceptable

3.06 FINAL BACKFILL

- A. Backfill remainder of excavation with native material, free from large clods, large stones, organic material or frost chunks unless otherwise specified below.
- B. Backfill within roadways, driveways, and shoulders.
 1. Conform to Section 02705 – Road Restoration for backfill requirements under roadways, driveways, and shoulders.
- C. Backfill around structures.
 1. Backfill and compact around manholes, valve boxes, and other appurtenances in 12-inch lifts.
 - a. Compact with a mechanical tamper to a density not less than 90% of the maximum dry density, determined by ASTM D 698.

- b. Compaction around structures in roadways, driveways, and shoulders shall conform to Section 02705.
 - 2. Backfill around septic tanks in 18-inch lifts.
 - a. Compact in a manner that will not produce undue strain on the tank.
 - b. Compaction may be accomplished with the use of water, provided the material is thoroughly wetted from the bottom up, and the tank is filled with water to prevent floating.
- D. Backfill of trenches and other locations not listed above.
 - 1. Compact in 18-inch lifts to a density not less than the density of the surrounding undisturbed soil.
 - 2. Provide 3 feet minimum of backfill over the pipe before wheel loading the trench.
 - 3. Provide 4 feet minimum cover over the top of the pipe before utilization of hydrohammer compaction equipment.
 - 4. Compact in smaller lifts if the required compaction cannot be obtained.
 - 5. Lifts may be increased at the discretion of the Project Engineer if required compaction can be obtained.
- E. Repair any trenches improperly backfilled or where settlement occurs, then refill and compact.
- F. Restore surface to the required grade and compaction. Conform to Section 02310 – Grading for rough grading, finish grading and site surface drainage.
- G. Remove all surplus backfill materials to a location approved by the Engineer.

3.07 FROST PROTECTION

- A. Place insulation in areas where water main, sewer service lines or water service lines cross a road, driveway, traveled path, as indicated on the plans or as directed by the Engineer.
- B. Center insulation over the main with no more than 6 inches of compacted fill between the pipe and the insulation. Grade fill so insulation lays flat.
- C. Maintain a straight alignment of insulation.

- D. Extend insulation a minimum of 5 feet on each side of the crossing.
- E. Lap insulation by 6 inches or stagger by 6 inches if composed of two layers.
- F. Minimum thickness for the first lift of backfill over the insulation is 8 inches.
 - 1. Do not operate construction equipment directly on insulation. Do not compact first lift with backhoe-mounted compactor, or any other large compaction equipment.
 - 2. Compact remaining backfill using normal construction practices.

3.08 POLYETHYLENE ENCASEMENT

- A. All metallic mainline pipe, fittings, and appurtenances installed in aggressive soils shall be wrapped with polyethylene in accordance with ANSI/AWWA C105/A21.5.
- B. The wrap shall extend 2-feet beyond all metallic fittings/appurtenances and cover the entire length of metallic pipe. All rips or punctures shall be repaired with tape or by rewrapping that area with polyethylene film.
- C. After assembling the pipe joint, the polyethylene shall be overlapped approximately 1-foot and at all joints sealed with approved adhesive tape. Additional taping shall be used at 3-foot intervals along the pipe. All copper service connections shall be wrapped for a distance of 3-feet from the center line of the main. Before installing the polyethylene wrap, the exterior of the pipe shall be free of foreign material.

3.09 REMOVAL OF NUISANCE WATER

- A. Remove nuisance water entering the trenches. Nuisance water that can be removed through the use of sump or trash pumps is not considered dewatering.
- B. Keep trenches free from water until the facilities are in place, sealed against the entrance of water, and backfill has been placed and compacted above the water level.

3.10 LOCATE EXISTING UTILITIES

- A. Field locate all existing underground utilities.
 - 1. Utilize state “dig-safe” or “one-call” hotlines.
 - 2. Contact all other utility owners not covered by the state “dig safe” hotlines.

3.11 UTILITY CONFLICTS

- A. Protect existing utilities from damage during excavation and backfilling operations.
- B. Provide temporary support for existing water, gas, telephone, power, or other utility services that cross the trench until backfilling of trench is complete
 - 1. Compact backfill to 95% of Standard Proctor Density under disturbed utilities.
 - 2. Repair or replace any damaged existing utilities, at no additional cost to the project.
- C. Water and sewer main crossing and parallel installation
 - 1. Maintain a 10 foot horizontal separation (O.D. to O.D.) for parallel mains.
 - 2. Upon approval by the Engineer, water and sewer mains may be installed closer than 10 feet, provided all of the following conditions;
 - a. Vertical separation is 18 inches (O.D. to O.D.)
 - b. Water main is above the sewer main.
 - c. Separate trenches are maintained.
 - 3. Maintain a minimum 18-inch vertical separation (O.D. to O.D.) for crossing mains.
 - a. Lay pipe with joints equidistant from the point of crossing.
 - 4. If it is impossible to meet any of the above separation distances and deviations, one of the following methods shall be adhered to.
 - a. Sewer main shall be constructed to water main pressure pipe standards, and successfully pass a 150-psi pressure test prior to backfilling.
 - b. Either the water main or the sewer main may be encased in a watertight carrier pipe that extends 10 feet on both sides of the crossing. The carrier pipe shall be of materials approved by the regulatory agency for use in water main construction.
- D. Water and sewer service crossing and parallel installation.
 - 1. Maintain a 30-inch horizontal separation from water and sewer services.

2. Maintain a 12-inch vertical separation for crossing water and sewer services.
3. Water service line splices or joints will not be permitted within 10 feet of a sewer line crossing.

3.12 MOVING FENCES AND MINOR STRUCTURES

- A. Remove and reset culverts, drainage pipes or other minor structures that fall within the alignment of the new construction, to their original location and grade.
- B. Visit the project site and determine actual conditions with regard to the existence of old car bodies, abandoned houses, fences, driveways, trees, stumps, brush, sidewalks, approaches, and other miscellaneous obstacles to construction.
 1. Unless specifically referenced in a bid item, no separate payment will be made for the removal or replacement of these items.

3.13 RECORDS

- A. Conform to as-built requirements in Section 01780 – Closeout Submittals.

END OF SECTION

**SECTION 02370
TEMPORARY EROSION AND SEDIMENT CONTROL**

PART 1 - GENERAL

1.01 SUMMARY

- A. This section includes temporary erosion and siltation control measures accomplished through the use of silt fences, hay bales, erosion mats and other erosion control devices or methods.

1.02 RELATED WORK (as applicable)

- A. Section 02310 – Grading
- B. Section 02315 – Excavation, Trenching and Backfill
- C. Section 02920 – Topsoiling, Seeding, Fertilizing and Mulching

1.03 REFERENCES

- A. Minnesota Pollution Control Agency – Best Management Practices Handbook
- B. Environmental Protection Agency - 1987 Congressional Amendments, Clean Water Act, Section 402.

1.04 SUBMITTALS

- A. Method of Erosion Control
- B. Silt Fence and Appurtenances
- C. Erosion Mats and Appurtenances
- D. Erosion Control Plan (If requested by the Engineer)

1.05 QUALITY ASSURANCE

- A. Erosion control materials, methods and practices shall conform to the applicable state agency handbooks of Best Management Practices, or tribal laws established for the purpose of erosion control on construction sites.
- B. Obtain and pay for permits and inspections in accordance with the provisions of all local government agencies having jurisdiction. No additional claim for compensation will be allowed because of the Contractor's failure to obtain or pay for such permits and inspections.

PART 2 - PRODUCTS

2.01 SILT FENCING

A. Applicability

1. Heavy Duty: General use during site grading to protect critical areas and bodies of water.
2. Standard: Light-duty applications to protect temporary construction or to supplement the other types of silt fence.
3. Machine-slice: For most applications.

B. Geotextile properties:

Description	Heavy Duty	Standard	Machine Slice
Type	Woven	Woven	Monofilament
Width	48 inches	36 inches	36 inches
Grab Tensile Strength (ASTM D 4632)	100 lb Min	100 lb Min	130 lb Min
Apparent Opening Size (ASTM D 4751)	20-70 Sieve	20-70 Sieve	30-40 Sieve
UV Stability (ASTM D 4355 500 hr)	70% Min	70% Min	70% Min
Top-fastening Component	Overlap around woven wire backing	Sewn-In cord	

* From Minnesota BMP

C. Net Backing

Description	Heavy Duty	Standard	Machine Slice
Material	Woven wire	N/A	N/A
Min. Weight	14-1/2 gauge		
Min. Mesh Opening	2 inches		
Max Mesh Opening	6 inches		
Min. Width	30 inches		
Tensile Strength (ASTM D 4595)	100 lb/ft		
UV Stability (ASTM D 4355 500 hr)	70% Min		

* From Minnesota BMP

D. Post properties:

Description	Heavy Duty	Standard	Machine Slice
Material	Metal	Wood	Metal
Min. Size	1.25 lb/ft	1.5 inch x 1.5 inch	1.25 lb/ft
Min. Length	5 feet	4 feet	5 feet
Min. Embedment	2 feet	1.5 feet	2 feet
Max. Spacing	8 feet	8 feet	6 feet
Type of Post Fasteners	U-shaped clips. No. 16 gauge wire	Gun staples 0.5 inch long	Plastic zip ties (50lb tensile strength)
Min. Fasteners per Post	3	5	3

* From Minnesota BMP

E. All seams shall be heat sealed or sewn

2.02 EROSION BALES

- A. Applicability: Can be used in locations where silt fencing is used.
- B. Rectangular clean hay bales or straw bale.
- C. Posts: Wood or steel, 2" x 2" x 54" minimum.

2.03 EROSION CONTROL MATS

- A. Biodegradable or photodegradable erosion control mat equal to American Excelsior Curlex II with a minimum 4-foot mat width.

2.04 OTHER

- A. Other materials proposed by the Contractor shall conform to standards published by the applicable state agency handbooks of Best Management Practices (BMP's).

PART 3 – EXECUTION

3.01 GENERAL

- A. Coordinate temporary and permanent erosion control measures to assure economical, effective and continuous erosion control.
- B. Keep construction areas small.
- C. Divert drainage away from construction areas.
- D. Perform construction in and adjacent to rivers, streams, lakes or other waterways in such a manner as to avoid washing, sloughing or deposition of material into waterways which will result in undue or avoidable contamination, pollution or siltation of such waterways.
- E. Inspect and maintain erosion control materials to ensure its continued effectiveness.
 - 1. Remove sediment material captured by erosion control systems before systems fails.
 - 2. Inspect and repair erosion control systems within 48 hours of rain event.
- F. Remove erosion control only after the area has stabilized and vegetation has developed to the extent that further erosion is unlikely.

- G. Submit a plan for erosion control measures that are in compliance with State BMPs and/or Federal EPA requirements, if the area to be disturbed is greater than one (1) acre total.

3.02 TEMPORARY EROSION CONTROL

- A. Use temporary erosion control measures to protect ditches and drainage ways as shown on the detailed drawings and as directed by the Engineer.

- B. Silt fencing (in lieu of or in combination with erosion bales)

1. Install silt fence in accordance with manufacturer’s recommendations.
2. Construct the silt fence as shown on the plans and/or install on the contour of the slope.
3. Place silt fences in an arc or horseshoe shape with the ends pointing up towards the slope.
4. Maximum drainage area = ¼ acre per 100 feet of fence
5. Installation limitations:

Slope Steepness	Maximum Slope Length
2:1 (50%)	15 feet
3:1 (33%)	15 feet
4:1 (25%)	15 feet
5:1 (20%)	25 feet
10:1 (10%)	50 feet
20:1 (5%)	75 feet

6. Compact the soil immediately next to the silt fence fabric.
7. Clean silt fence when sediment reaches 1/3 height of the silt fence.

- C. Erosion Bales

1. Install hay bales as shown on the plans and/or install on the contour of the slope.
2. Installation limitations:

Slope Steepness	Maximum Slope Length
2:1 (50%)	15 feet
3:1 (33%)	15 feet
4:1 (25%)	15 feet
5:1 (20%)	25 feet
10:1 (10%)	50 feet
20:1 (5%)	75 feet

3. Install hay bales in 4-inch deep trench.
4. Place bales at right angles to the direction of flow.
5. Securely anchor each bale with stakes as shown on the plans.
6. Compact soil on the upslope side of the hay bales.
7. Fill gaps between bales with straw.
8. Clean sediment away from bale when sediment reaches 1/2 height of the hay bale.
9. Replace damaged, destroyed or rotted bales immediately.
10. Bales may be used for mulching material if they meet the specifications of Section 02920.

D. Erosion Control Mats

1. Where indicated on the plans, by the Project Engineer, or on slopes greater than 5%, use a wood fiber mat in lieu of mulch.
2. Install in accordance with manufacturer's recommendations
3. Roll matting strips in the direction of the flow.
4. Spread mat evenly, smoothly, and in a natural position without stretching and with all parts touching the soil.

END OF SECTION



This Page Intentionally Left Blank

**SECTION 02541
PRESSURE DOSED MOUND SYSTEM (MDO VERSION)**

PART 1 - GENERAL

1.01 SUMMARY

- A. This section includes the installation and construction of an individual waste water disposal system composed of a pump chamber, pump, controls, piping and a mound disposal field.

1.02 RELATED WORK (as applicable)

- A. Section 01780 – Closeout Submittals
- B. Section 02315 – Excavation, Trenching and Backfill
- C. Section 02545 – Concrete Septic Tank and Piping

1.03 REFERENCES

- A. ASTM D1785 – Polyvinyl Chloride (PVC) Plastic Pipe Schedule 40, 80 and 120.
- B. ASTM D2241 – Polyvinyl Chloride (PVC) Pressure-Rated Pipe (SDR Series)
- C. ASTM C33 – Standard Specification for Concrete Aggregates
- D. National Electric Code (NEC)

1.04 SUBMITTALS

- A. Pump Chamber, Riser and Cover
- B. Effluent Pump, Controls and Alarm System
- C. Force Main, Manifold, and Lateral Piping
- D. Source of Mound Material, Drainfield Gravel and Sieve Analysis for Clean Sand, or Distribution Media
- E. Synthetic Gravel Cover

PART 2 - PRODUCTS

2.01 CONCRETE PUMP CHAMBER

- A. Fabricate from watertight reinforced concrete as shown on the attached drawings.
- B. Comply with applicable state requirements. Refer to Section 02545 for appropriate state references.
- C. Volume of container is listed in the bid schedule.
- D. Combination septic tank/ pump tanks are acceptable, provided they meet applicable state requirements. Refer to Section 02545 for septic tank requirements.
- E. Manhole risers and covers
 - 1. Provide at least one manhole opening, no less than 24 inches square or 24 inches in diameter, situated over the pump.
 - 2. Manhole riser shall be cast in place polyethylene with gasketed connections or other approved water-tight material. Extend riser 6-inches above finished grade.
 - 3. Covers shall be of the same material as the riser, with a warning label, printed with information regarding the hazards present when entering a septic tank affixed or supplied by the manufacturer. Cover shall be secured to the riser with locking screws or approved equal.

2.02 PUMPS AND CONTROLS

- A. Effluent Pump Requirements
 - 1. 1/2 horsepower, 115/230 volt, single phase submersible, 2 inch discharge outlet, capacity of 50 gpm against a total dynamic head of 20 feet unless specified otherwise in Section 01119.
 - 2. Equal to Peabody Barnes Model EH522, Myers Model ME 50, Goulds Model 3885 or Zoeller 270.
- B. The Engineer will determine the type and size of pump to be used.
- C. The pump motor shall have a built-in thermal overload protection with automatic reset.
- D. Install two mechanical float switches to detect on-off control levels for the pump.
 - 1. Use SJE Rhombus Signal Master Control Switch or equal.

- E. Power Supply Requirements: 120/240 volt, single phase, three wire service from one/two pole breaker off lighting panel in the residence on a separate/dedicated circuit.
 - 1. Use wire sized in accordance with NEC.

- F. Controls: Furnish and install controls to operate the pump based on on-off level control floats.
 - 1. Option #1: A control panel compatible with the pump supplied and housed in a weatherproof enclosure equal to a NEMA Type 4X fiberglass enclosure.
 - a. Provide terminal blocks for connection of on-off level control floats.
 - b. A separate dead front enclosure section shall house a load switching motor contactor with door mounted heavy-duty hand-off-auto switch and a service disconnect mechanism.
 - c. Equal to Rhombus Inc., Model 1120W115H1E10E11C17A, phone (218) 847-1317 / (888) 342-5753 or approved equal
 - 2. Option #2: Pump Switch with Piggy-Back Plug and outlet rated for exterior use and housed in a weatherproof enclosure equal to a NEMA Type 4X fiberglass enclosure.
 - a. Size pump switch to be compatible with selected pump (ie voltage and horsepower rating)
 - b. Enclosure area shall be a minimum of 1.5 times the area of the piggyback switch, outlet, and folded cables to allow for easy access, removal, and replacement of switch, outlet, and cables.
 - c. Size power cable in accordance with the NEC.
 - d. Equal to Rhombus Inc, Double Float pump switch.
 - 3. Provide terminal blocks for connection of on-off level control floats.

- G. Provide an alarm system on a separate circuit from the pump.
 - 1. Alarm system shall consist of a direct acting mechanical float switch, 24-volt control transformer, red alarm light, horn, push-to-test alarm button and a horn silence switch.

2. The indoor alarm system shall be Powertronics Model MD 3875, Rhombus Model 101-01H(Tank Alert 1) or approved equal.
3. Outdoor alarm on the control panel is a contractor option. Rhombus Control panel Model #1121W111H10E or approved equal.

2.03 ELECTRICAL CABLE

- A. Electrical cable shall be type UF for direct burial.
- B. Use 12/2 wire with ground to provide power to the effluent pump.
- C. Use 14/2 wire to provide power to the float switches.
- D. Size underground cable to limit voltage drop from power source to pump motor in accordance with pump manufacturer's recommendations.

2.04 FORCE MAIN AND MOUND PIPING

- A. Force main piping shall be PVC (160 psi SDR 26 or Schedule 40). The diameter shall be as indicated on the design drawings.
- B. Manifold piping shall be PVC (160 psi SDR 26 or Schedule 40). The diameter shall be as indicated on the design drawings.
- C. Lateral piping shall be PVC (160 psi SDR 26 or Schedule 40). The pipe shall be field perforated. The pipe diameter shall be as indicated on the design drawings.
- D. Observation pipes shall be 4-inch solid cast iron pipe or Schedule 40 PVC.

2.05 MOUND MATERIAL AND DISTRIBUTION MEDIA

- A. Clean sand shall meet the following requirements for fine aggregate (ASTM C33):

Sieve No.	Percent Finer by Weight
3/8 inch	100%
No. 4	95-100%
No. 8	80-100%
No. 16	50-85%
No. 30	25-60%
No. 50	10-30%
No. 100	2-10%
No. 200	0-3%

- B. Distribution Media Options:
 - 1. Drainfield Gravel: Gravel shall be clean and may vary in size from ½-inch to 2 inches, with not more than 5 percent fines below the ½-inch size.
 - 2. Infiltrators Systems Inc, Quick 4 Standard Chambers or approved equal.
 - 3. Infiltrators Systems Inc, EZ Flow Systems or approved equal.
- C. Synthetic material shall be TYPAR Style 3151 or equal.
- D. Fill material may be subsoil if it is not heavy clay or glacial till, with stones and boulders. Sandy loam is the preferred material.
- E. The seed mixture shall be recommended by a local agricultural extension agent and shall be approved by the Engineer.

PART 3 - EXECUTION

3.01 CONCRETE PUMP CHAMBER AND PUMP

- A. Install 4-inch Schedule 40 PVC from the septic tank to pump chamber.
- B. Seal all joints between inlet piping, vent pipe, riser, etc. to eliminate ground water infiltration, as approved by the Engineer.
- C. Install vent on pump chamber in accordance with state codes.
- D. Install all buried electrical cable (1 pump wire and 3 float switch wires) in one trench.
- E. Floats:
 - 1. Mount floats in pump chamber as directed by Engineer.

3.02 CONTROL PANEL AND ALARM SYSTEM

- A. Install all wiring in accordance with the NEC.
- B. Mount control panel in a location specified by the Engineer.
- C. Seal all conduit openings entering the control panel and pump chamber with silicone caulk or other appropriate material.
- D. Install the alarm system in the residence in a location to be selected by the Engineer and homeowner.

1. Install the alarm system on a separate circuit from the pump.
2. Set up the alarm so that upon the occurrence of an alarm condition, the high alarm sensor will close its circuit, thus energizing the red alarm light and sounding the horn.
3. Provide a switch that when moved from the “normal” to “silence” position will silence the audible alarm, and allow the red alarm light to remain energized.
4. The high alarm sensor shall continue to show an alarm condition until the operating condition has returned to normal and the silencing switch has been returned to its “normal” position.

3.03 FORCE MAIN, MANIFOLD, AND LATERAL PIPING

- A. Install force main piping and union in the pump chamber, as shown in the detail drawings, to allow the removal of the pump through the riser by only disconnecting the union.
 1. Union shall be a maximum of 24 inches below top of tank riser.
- B. Alternative discharge piping layout: exit through the pump tank opening.
 1. Discharge piping shall be brought up into the riser so that the union is within 24 inches of the top of the tank riser.
 2. Drill a 1/4-inch weep hole in the bottom elbow of the outlet pipe.
- C. Slope force main continuously up to the mound unless otherwise directed by the Engineer.
- D. Trench force main pipe up to the mound area and slope into the mound within the fill from the upslope side or the end of the mound per the design drawings.
- E. Mound Distribution Piping:
 1. Install piping per design completed and/or approved by Engineer and as shown in the drawings.
 2. Field perforate lateral piping per approved plan using sharp drill bit.
 3. Remove all burrs and filings from the interior of the pipe.
 4. Pressure distribution pipe cleanouts must be installed and accessible from final grade to verify system for proper operation and for cleaning of plugged perforations.

F. Refer to Section 02315 for excavation and backfilling procedures.

3.04 MOUND SURFACE PREPARATION

- A. Approval for surface preparation shall be obtained from the Engineer.
- B. If tree removal is required, cut trees flush with the ground and remove. Leave stumps in the ground.
- C. Remove excessive vegetation from the mound area by clearing and mowing.
- D. Plow, with a chisel type plow, perpendicular to the slope.
- E. Scratching of the surface by a backhoe may be allowed with approval of the Engineer.
- F. Obtain a minimum plowing depth of 7 to 8 inches below original grade.

3.05 MOUND CONSTRUCTION

- A. Application of mound basal sand must be completed immediately after surface plowing has been accomplished.
- B. Place a minimum of 12 inches of clean sand upon plowed surface, below drainfield gravel.
- C. Place sand by dumping along the upslope side and/or ends of the plowed area.
- D. Use a crawler tractor with a blade to spread the sand, keeping at least 6 inches of sand under the tracks at all times.
- E. Distribution Media Construction:
 - 1. Drainfield Gravel: Install drainfield gravel approved by the Engineer and as shown on the detail drawings with a crawler tractor.
 - 2. Manufactured Media: Install media approved by the Engineer and as shown on the detail drawings.
- F. Refer to 3.03 for manifold and lateral piping installation requirements.
- G. Install observation pipes at locations shown on design drawings so that the bottoms of the observation pipes are flush with the infiltrative surface of the mound (gravel/sand interface).

- H. Observation pipes shall be constructed per the detail drawing, fitted with a secure state approved cover, and extended 12 to 24 inches above grade.
- I. Cover drainfield gravel with synthetic material as shown in detail drawings.
- J. Place fill material above the drainfield gravel as shown on the detail drawings.
 - 1. The fill material layer shall be a minimum of 12 inches deep at the center of the mound and a minimum of 6 inches deep at the sides.
- K. Cover the entire mound with a minimum of 6 inches of topsoil.
- L. Seed and mulch entire mound area to provide immediate erosion control as recommended by a local agricultural extension agent.
- M. Repairing erosion damage and re-seeding the mound area is required until a complete vegetation cover is achieved.

3.06 FIELD QUALITY CONTROL

- A. No plowing shall take place when the moisture content of the soil, at a depth of 7 to 8 inches, is such that rolling a sample between the hands forms a roll.
- B. The Engineer reserves the right to conduct a field test of mound sand and reject the aforesaid sand should it fail to meet the gradation requirements.
- C. No rubber tired or wheeled equipment or material stockpiles will be allowed on the mound basal area and/or the designated down-slope area.

3.07 AS-BUILTS

- A. Provide as-built information on each system in accordance with Section 01780. Use IHS forms (if supplied) by the Engineer.

END OF SECTION

**SECTION 02545
CONCRETE SEPTIC TANK AND PIPING**

PART 1 - GENERAL

1.01 SUMMARY

- A. This section covers single and multiple compartment, rectangular and cylindrical precast septic tanks. Also included is the piping from the home to the septic tanks along with two-way cleanouts and septic tank abandonment.

1.02 RELATED WORK (as applicable)

- A. Section 01119 – Revisions to Standard Specifications
- B. Section 01780 – Closeout Submittals
- C. Section 02315 – Excavation, Trenching and Backfill
- D. Section 02540 – Drainfields
- E. Section 02541 – Pressure Dosed Mound System (Minnesota)
- F. Section 02542 – Pressure Dosed Mound System (Michigan and Wisconsin)

1.03 REFERENCES

- A. ASTM D 1785 – Polyvinyl Chloride (PVC) Plastic Pipe Schedule 40, 80 and 120.
- B. ASTM D 3034 – Type PSM Polyvinyl Chloride (PVC) Sewer Pipe and Fittings.
- C. Minnesota Pollution Control Agency, Chapter 7080 – Individual Sewage Treatment Systems
- D. State of Wisconsin, Industry and Human Relations Committee. Chapter 83, Private Onsite Wastewater Treatment Systems. Chapter 84, Plumbing Products.
- E. State of Michigan, Western Upper Peninsula District Health Department, Superior Environmental Health Code.
- F. State of Michigan, Public Health Code, Act 368.

1.04 SUBMITTALS

- A. Septic tank (including wire mesh detail or manufacturers literature on fibers)
- B. Septic tank riser and cover.
- C. Effluent Filter

- D. Solid sewer pipe
- E. Cleanout and Inspection plug

1.05 QUALITY ASSURANCE

- A. Septic tanks and other materials shall meet minimum requirements of the appropriate state agency regulating onsite septic systems.

PART 2 - PRODUCTS

2.01 SEPTIC TANKS

A. Septic Tank Requirements

- 1. Min. reinforced concrete wall thickness 2 inches
- 2. Minimum capacity below outlet 1,000 gallons, or as specified on the bid schedule
- 3. Minimum liquid depth 2 1/2 feet
- 4. Maximum liquid depth 5 1/2 feet
- 5. Concrete compressive strength 3,000 psi

- B. Rectangular tanks shall have a minimum width of 36 inches and be constructed with the longest dimension parallel to the direction of flow.

- C. Reinforce throughout with 6-inch x 6-inch – 10/10 wire mesh or fiber mesh.

- D. Cylindrical tanks shall have an inside diameter of not less than 48 inches.

- E. Joints below the liquid level shall be of monolithic construction or have interlocking V-notch, shiplap or tongue and groove joints.

F. Inlet and Outlet

- 1. Provide tanks with inlet and outlet connections for 4-inch Schedule 40 PVC.
- 2. Provide rubber boots on all inlet and outlet openings to prevent the insertion of the sewer piping beyond the inside wall of the tank.
- 3. Provided an open-end coated sanitary tees or baffles made of approved materials at the inlet.
- 4. Tees or baffles shall extend at least 6 inches above and 9 inches below the liquid level, but not exceed 1/3 of the liquid depth.
- 5. Provide at least 2 inches of clear space over the top of tees or baffles.

6. The bottom of the outlet opening shall be at least 2 inches lower than the bottom of the inlet.

G. Manhole Risers and Covers

1. Provide at least two manhole openings, no less than 24 inches square or 24 inches in diameter, with each single or multiple compartment tanks, situated over the inlet pipe & baffle and outlet pipe & effluent filter.
2. Manhole riser shall be cast in place polyethylene with gasketed connections or other approved water-tight material.
3. Covers shall be of the same material as the riser, with a warning label, printed with information regarding the hazards present when entering a septic tank affixed or supplied by the manufacturer.

H. Septic tanks must conform to state specific codes identified in Section 1.03 References.

2.02 SOLID SEWER PIPE, CLEANOUT AND FITTINGS

- A. Schedule 40 PVC fittings and caps shall conform to ASTM D 1785.
- B. SDR 35 PVC pipe and fittings shall conform to ASTM D 3034.
- C. Cleanout piping and cap shall be PVC and threaded if installed above ground. Plug shall be cast iron and threaded if installed below ground.
- D. Frost Sleeve (WI and MI only)
 1. Schedule 40 PVC or SDR 35 PVC
 2. Cap: Slip on or threaded
 3. Diameter: 2-inches bigger than cleanout diameter
 4. Minimum length: from ground surface to elbow

2.03 EFFLUENT FILTER

- A. Rated for 3,000 gpd flow rate.
- B. Maximum filter opening, 1/16 inch.
- C. Equal to Polylok PL-525 or Zabel A100 (12 x 20 inches).

2.04 PIPE HANGERS

- A. Shall be made of a material compatible with piping material.

- B. Shall be of sufficient strength to support the pipe at full capacity.
- C. Shall not affect pipe integrity by either abrading, cutting or bending of pipe.

PART 3 - EXECUTION

3.01 SOLID SEWER PIPE and CLEANOUTS

- A. Install solid sewer pipe from the house to the septic tank.
 - 1. Connect to the existing home sewer stub out if present underground outside the home.
 - 2. For connecting beneath the home, place pipe hangers at a maximum distance of 4 feet apart for horizontal PVC pipe.
 - 3. Cap sewer service, and stake if no connection is made.
 - 4. Install a frost sleeve for the vertical service line connection beneath the home from 2" above grade to within 6" of the top of the below ground horizontal sewer service line for a mobile home connection.
- B. Minimum cover over solid sewer pipe is 12-inches.
- C. Insert inlet piping to be at least 6 inches, but no more than 12-inches from baffle.
- D. Schedule 40 PVC pipe shall extend from the septic tank inlet and outlet a minimum of 12-inches past the edges of the tank excavation.
- E. Minimum slope between the house and the septic tank is 1/8-inch per foot or 6 inches, which ever is greater.
- F. There shall be no 90-degree bends in the pipe between the house and the Septic tank.
- G. Install two-way cleanouts approximately 5 feet from the outside wall of each home or mobile home.
 - 1. Cleanout shall allow rodding the sewer line both towards the home and towards the septic tank.
 - 2. Fit cleanout with a threaded plug.
 - 3. Install cleanout so the top is flush with the ground or as specified by the Engineer.

4. Install frost sleeve around each cleanout riser.
 5. Install vertically a piece of No. 3 rebar, 1-foot in length, next to each cleanout riser. Bury rebar 6 inches below ground surface.
- H. Properly seal pipe connections to tanks to prevent groundwater infiltration.
 - I. Terminate inspection opening 6 inches above final grade and securely cap.
 - J. Solvent weld all joint connections.
 - K. Install insulation in traveled areas as specified by the Engineer in accordance with Section 02315 – Excavation, Trenching and Backfill.

3.02 TANK INSTALLATION

- A. Place tanks in excavations at the locations and elevations designated on the plans or by the Engineer.
- B. Refer to Section 02315 for excavation, backfill, and grading requirements.
- C. Place tanks level.
- D. Install tanks in accordance with manufacturer's recommendations.
- E. Seal joints when the tank is set with an epoxy based sealing compound or Rub-R-Nek flexible gasket, as manufactured by the Henry Group (formerly K.T. Snyder Company Inc.), Houston, Texas, or equal.
- F. Seal inlet and outlet with temporary plugs until connections are made to the inlet and outlet lines.
- G. Set the top of the tank a minimum of 6-inches below finished grade. Do not exceed 24-inch cover depth unless tank is designed for deeper bury depth and Engineer approves.
 1. Install manhole risers and terminate access cover 3-6-inches above finished grade. Provide suitable locking screws or locking device that meets with Engineer's approval.
 2. Where manhole risers are required more to be than 24 inches in height, risers and manhole shall be made of concrete with approved watertight seals.
- H. Do not drive over the tank during and after construction.

3.03 EFFLUENT FILTER

- A. Center filter under the outlet manhole opening.
- B. Solvent weld to 4-inch PVC Schedule 40 outlet pipe. Extend a minimum of 12-inches beyond the outside of the septic tank before connecting to SDR 35 pipe.
- C. Install filter handle and extend handle to within 6-inches of the top of the access riser for easy access.
- D. Conform to manufacturer's installation instructions.

3.04 EXISTING SEPTIC TANK ABANDONMENT

- A. Abandon existing septic tanks and/or wet wells where directed by the Engineer.
- B. Pump tanks prior to abandonment. Dispose the contents in accordance with state and federal requirements.
- C. Remove and dispose of any interior pipes, plumbing, or pumps.
- D. Remove and dispose of concrete tank cover, risers, and inspection pipes.
- E. Backfill interior of the tank with suitable, compactable soil material.
- F. Conform to section 02310 – Grading, and section 02920 – Topsoiling, Seeding, Fertilizing and Mulching.
- G. Locate abandoned septic tanks on the as-built drawing.

3.05 AS-BUILTS

- A. Provide as-built information on each system in accordance with Section 01780.

END OF SECTION

**SECTION 02920
TOPSOILING, SEEDING, FERTILIZING, AND MULCHING**

PART 1 - GENERAL

1.01 SUMMARY

- A. This section includes topsoiling, seeding, fertilizing, and mulching areas disturbed by construction activities.

1.02 RELATED WORK (as applicable)

- A. Section 02310 – Grading
- B. Section 02370 – Temporary Erosion and Sediment Control

1.03 REFERENCES

- A. Minnesota Department of Transportation – Seeding Manual 2007 Edition.

1.04 SUBMITTALS

- A. Topsoil
- B. Seed Mixture and Application Rate Data
- C. Mulching Material

PART 2 - PRODUCTS

2.01 TOPSOIL

- A. Natural loam, sandy loam, silt loam, silty clay loam, or clay loam humus-bearing soils adapted to the sustenance of plant life.
- B. Neither excessively acid nor excessively alkaline.

2.02 FERTILIZER

- A. Use a 20-10-10 mixture of 20% Nitrogen, 10% Phosphorous, and 10% Pot Ash.

2.03 SEED MIXTURE

- A. Use Minnesota DOT seed mixture #240 or other Engineer accepted seed mixture for well drained sandy soils:

Minnesota DOT Seed Mixture #240

13%	Smooth Brome Grass
27%	Kentucky Bluegrass
13%	Canadian Bluegrass
2.5%	Switch Grass
4.0%	Slender Wheat-grass
7.0%	“Reliant II” Hard Fescue
20%	Perennial Rye-grass
2.5%	Sand Dropseed
3.5%	Little Bluestem
7.0%	Red Clover
0.5%	Purple Prairie Clover

- B. Use Minnesota DOT seed mixture #250 or other Engineer accepted seed mixture for average loam, heavy clay or predominately moist soils:

Minnesota DOT Seed Mixture #250

14%	Smooth Brome Grass
29%	Kentucky Bluegrass
14%	Canadian Bluegrass
3.0%	Switch Grass
21%	Perennial Rye-grass
3.0%	Timothy
3.0%	Redtop
6.0%	Creeping Alfalfa
3.0%	White Clover

2.04 MULCHING MATERIAL

- A. Straw or hay

PART 3 - EXECUTION

3.01 TOPSOIL

- A. After grading is completed, spread stockpiled topsoil over all disturbed areas, excluding those where another type of finished surface is being provided.

3.02 FERTILIZING

- A. Work soil to be seeded until soil is reasonably even and loose.
- B. Fertilize all topsoiled areas using 20-10-10 fertilizer at an application rate of 400-600 pounds per acre.

3.03 SEEDING

- A. Sow seed using either equipment suited to that purpose or scatter seed uniformly over area with hand seeders when the weather is sufficiently quiet to prevent seeds from blowing away. Use an appropriate method and rate as directed by the Mn/DOT Seeding Manual.
- B. Lightly rake soil to cover the seed with approximately $\frac{1}{4}$ inch of soil.

3.04 MULCHING

- A. Place hay or straw mulching on seeded area loose enough to allow some sunlight to penetrate and air to circulate but thick enough to shade the ground, conserve soil moisture, and prevent/reduce erosion.
- B. Do not perform mulching activities during periods of excessively high winds, which would preclude the proper placing of the mulch.
- C. Apply straw or hay uniformly over the disturbed area to a loose depth of $\frac{1}{2}$ to $1\frac{1}{2}$ inches using $1\frac{1}{2}$ to 3 tons of mulch per acre.
- D. Immediately after spreading, anchor mulch using a mulch tiller consisting of a series of dull flat discs with notched edges or other approved equipment.
- E. Anchor mulch to a depth of approximately $1\frac{1}{2}$ to $2\frac{1}{2}$ inches in the soil.

3.05 QUALITY CONTROL

- A. All work necessary for topsoiling, fertilizing, seeding and mulching shall be completed to insure adequate re-establishment of vegetation.
- B. The Contractor is responsible for re-establishing vegetation.

END OF SECTION



This Page Intentionally Left Blank